



REFERENCE MILL FOR INTEGRATED CARTONBOARD 2024

RAPPORT 2025:1096

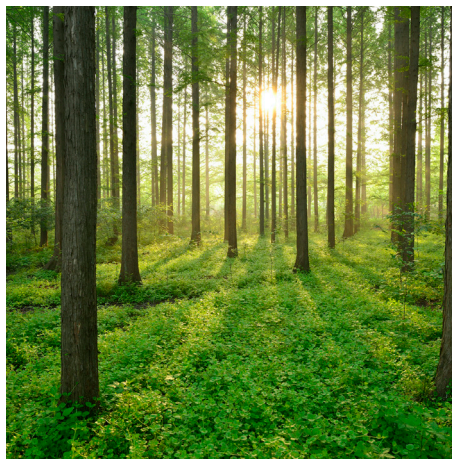

SKOGSINDUSTRIELLA
PROGRAMMET



Reference mill for integrated cartonboard 2024

NIKLAS BERGLIN, ANNA VON SCHENCK, MAGNUS IVARSBÄCKE,
PATRIK LÖWNERTZ, ÅSA SIVARD, THÉRÈSE JOHANSSON, TOM KARLSON,
JOHANNA SMEDBERG, HÅKAN MATTSSON, MÅRTEN DAHL, LENNART DELIN

ISBN 978-91-89919-96-9 | © Energiforsk March 2025

Energiforsk AB | Phone: 08-677 25 30 | E-mail: kontakt@energiforsk.se | www.energiforsk.se

Foreword

There is great value in developing reference mills to show how energy-efficient new mills can be built based on current technologies. The pulp and paper industry has a central role in the transition to greater use of sustainable materials and renewable energy. It is in the interest of both industry and society that production takes place in the most resource-efficient way possible. The ability to compare their processes with the best available technology is important to drive development. Previously developed model and reference factories have facilitated the possibilities to systematically evaluate the integration of new process concepts with existing processes.

The main objective of the project has been to define, in a well-established process, updated reference mills with detailed overall material and energy balances that can be used, for example, to show how energy-efficient mills can be built using existing and proven technology and to highlight the potential for energy savings in the industry. The project's goal has also been to show the potential for extracting energy from the pulp and paper industry with existing production.

This report describes a mill that produces liquid packaging board from kraft pulp produced internally.

The project has resulted in two reports, 2025-1096 Reference Mill for Integrated Cartonboard and 2025-1095 Reference Mill for Bleached kraft market pulp

Stockholm i March 2025

Marie Kofod-Hansen

Ansvarig för Skogsindustriella programmet

These are the results and conclusions of a project, which is part of a research programme run by Energiforsk. The author/authors are responsible for the content.

Summary

The purpose of this study was to update hypothetical “reference mills”, representing the state-of-the-art of pulp and paper production in the Nordic countries. These model mills have been developed in several versions going back all the way to the 1970s. The main emphasis has been on solutions which have affected energy use and electricity production. The reference mills have typically been used for benchmarking and for evaluating new process concepts in relation to the reference concept.

Two different types of pulp and paper mills were considered:

- Bleached kraft market pulp – one softwood mill and one hardwood mill
- Integrated cartonboard mill, with the pulp mill producing softwood and hardwood pulp in campaigns

This report describes a mill that produces liquid packaging board from kraft pulp produced internally. A separate report describes the bleached kraft market pulp mill.

In this report the pulp mill is considered to be a single line mill with a maximum continuous rate (MCR) of 2000 ADt/d when producing bleached softwood pulp and 2400 ADt/d when producing bleached hardwood pulp.

Some unbleached pulp, 300 ADt/d, is taken directly to the board machine, and the board machine also uses some purchased bleached chemi-thermochemical pulp (BCTMP). The board machine is designed to produce 600 000 tonnes of liquid packaging board per year.

Bleached pulp produced in excess of that needed by the board machine is dried and sold as market pulp. Configurations are based on AFRY's experience with existing mills and input from the major mill equipment suppliers. Mass and energy balances have been calculated using spreadsheet models developed by AFRY.

Keywords

Cartonboard, steam, power, energy, model

Sammanfattning

Syftet med denna studie var att uppdatera hypotetiska "referensfabriker" som motsvarar modern massa- och pappersproduktion i de nordiska länderna. Dessa modellfabriker har utvecklats i flera versioner ända sedan 1970-talet. Tyngdpunkten har legat på faktorer som påverkar energianvändning och elproduktion. Referensfabrikerna har använts för benchmarking och för att utvärdera nya processkoncept i förhållande till grundkonceptet.

Två olika typer av massa- och pappersbruk inkluderades:

- Fabriker för blekt avsalumassa – från barrved respektive lövved
- Integrerad kartongfabrik, där massabruket producerar barr- och lövvedsmassa i kampanjer

Denna rapport beskriver ett integrerat bruk som producerar vätskekartong av huvuddelen av sulfatmassan, men också producerar en del torkad och blekt sulfatmassa för avsalu. En separat rapport beskriver den fabrik som producerar enbart avsalumassa.

I denna rapport antas massabruket ha en fiberlinjes som körs i kampanjer med barrved respektive lövved, i en maximal kontinuerlig hastighet (MCR) på 2000 ADt/d vid framställning av blekt barrvedsmassa och 2400 ADt/d vid framställning av blekt lövvedsmassa.

En del oblekt massa, 300 ADt/d, tas direkt till kartongmaskinen, och kartongmaskinen använder även en del inköpt blekt kemisk-termomekanisk massa (BCTMP). Kartongmaskinen är konstruerad för att producera 600 000 ton vätskekartong per år.

Blekt massa som produceras utöver vad som behövs för kartongmaskinen torkas och säljs som avsalumassa. Konfigurationerna är baserade på AFRYs erfarenhet av befintliga bruk och input från leverantörerna av utrustning. Mass- och energibalanser har beräknats med hjälp av kalkylbladsmodeller utvecklade av AFRY.

List of content

1	Introduction	8
1.1	Scope and purpose	8
1.2	Brief history of the reference mills	8
2	Reference mills - overview	11
2.1	General design criteria	11
2.2	Mill production and capacity	12
2.3	Energy systems and balances	14
3	Process Description	16
3.1	Wood supply	16
3.2	Woodyard	16
3.3	Digester	16
3.4	Brownstock deknottling and screening	18
3.5	Oxygen delignification	18
3.6	Pulp washing	18
3.7	Bleaching	19
3.8	Board machine	21
3.8.1	Capacity & process concept	21
3.8.2	Stock preparation	22
3.8.3	Freshwater system	25
3.8.4	White water system and buffer volumes	25
3.8.5	Energy aspects of the board machine	25
3.9	Pulp dryer	26
3.9.1	Secondary screening, wet end and press section	26
3.9.2	Dryer and heat recovery	27
3.9.3	Cutter-layboy and baling	27
3.10	Chlorine dioxide generation	27
3.11	Oxygen supply	27
3.12	Evaporation	28
3.12.1	Handling of condensates	29
3.12.2	Handling of non-condensable gases	29
3.12.3	Tall oil recovery	30
3.13	Recovery boiler	30
3.14	Causticizing	32
3.15	Lime kiln	33
3.16	Power boiler	35
3.17	Steam turbines and steam distribution	35
3.18	Cooling and recovery of low-temperature heat	36
3.19	Effluent treatment	37
3.20	Spill handling system	39

	3.21	Water supply and treatment	40
4		Reference mills - energy balances	42
5		References	46

1 Introduction

1.1 SCOPE AND PURPOSE

The purpose of this study financed by Energiforsk was to update the hypothetical reference mills, which have been developed in several versions, going back all the way to the 1970s [1-4]. Revisions have been done with intervals of 5-15 years to reflect the technical changes that have occurred in recent years. The most recent update was done in 2010.

The main emphasis has been on changes which have affected energy use and electricity production. The reference mills have typically been used for benchmarking and in many other studies for evaluating new process concepts in relation to the “standard” concept.

Two different types of pulp and paper mills were considered:

- Bleached market kraft pulp mills – one softwood mill and one hardwood mill
- Integrated cartonboard mill, with the pulp mill producing softwood and hardwood pulp in campaigns

Modifications made in this study are based on AFRY’s experience with existing mills, and in some cases data from the major mill equipment suppliers. Material and energy balances have been calculated for the 2024 reference mills using spreadsheet models developed by AFRY.

The market pulp mills and the integrated pulp and paper mill are described in separate reports, although much of the information on the pulp mill is the same for both. This report describes the integrated cartonboard mill.

1.2 BRIEF HISTORY OF THE REFERENCE MILLS

The first versions of the reference or “model” mills were created in response to the first oil crisis in 1973, when SCPF (now Skogsindustrierna) commissioned ÅF (now AFRY) to carry out an investigation into how energy-efficient a mill could be built using the best available technology. Four main types of mills were included: linerboard, tissue paper, bleached market pulp and newsprint. The model mills were assumed to be newly built with the most modern technology already in operation, or that could be purchased with customary supplier guarantees, and able to meet the environmental limits.

Towards the end of the 1980s, updated versions were prepared by ÅF in a project co-financed by STU [1], and again in the late 1990s within the “Eco-Cyclic Pulp Mill Program” co-financed by MISTRA [2]. The most recent revisions were done jointly by STFI and ÅF in the 2004 FRAM (Future Resource-Adapted Mill) project co-funded by the Swedish Energy Agency [3], and in a 2010 study co-funded by ÅForsk and the Swedish Energy Agency [4, 5]. All projects have been co-funded by forest industry companies, which have usually been very active in discussions and definitions. The hypothetical mills have been referred to as “model mills”, “ideal

mills” and “reference mills” in different studies but have always been developed with the same general approach as the first versions. This report thus continues a 50-year long tradition of summarizing energy balances for state-of-the-art pulp mills.

2 Reference mills - overview

2.1 GENERAL DESIGN CRITERIA

The main product of the mill is assumed to be liquid packaging board produced from a fiber furnish consisting of:

- Bleached softwood pulp
- Unbleached softwood pulp
- Bleached hardwood pulp
- Bleached chemi-thermomechanical pulp

The mill is designed with one kraft fiberline to produce all bleached and unbleached pulp required by the board machine. A considerable amount of bleached softwood pulp is produced in excess of that needed by the board machine. This pulp is dried and sold as market pulp

Two different feedstocks were considered for the reference mills producing bleached kraft pulp:

- softwood (pine/spruce)
- hardwood (birch)

The design of the reference mill is based on best available and commercially proven technology. The mill configuration largely represents solutions used in the Nordic countries.

The design of the mill considers:

- high quality liquid packaging board
- high, consistent pulp quality which is competitive on the international market
- the pulp product is elemental chlorine free (ECF)
- low specific consumptions of wood, chemicals, and water
- high energy efficiency
- maximized production of bio-energy, and minimal usage of fossil fuels
- low environmental emissions; on the level of newer modern mills
- cost-effective solutions

Different suppliers offer process equipment of various types. The reference mills are not based on equipment from any one supplier. In general, the key process data used in the balances in this study are conservative and should not exclude any of the major pulp mill equipment suppliers.

2.2 MILL PRODUCTION AND CAPACITY

Pulp production capacity in the industry varies widely from older mills producing less than 1000 ADt/d to newer single line mills which operate at >4000 ADt/d. Board machines are built to produce up to 1.2 million tonnes per year, but the largest machines producing liquid packaging board have a capacity up to 600 000 tonnes per year.

Some board machines are built in stand-alone mills, where all pulp is purchased on the market to provide suitable fiber furnishes for a wide variety of product qualities. In the Nordic countries it is most common to have board machines integrated with kraft pulp production. Usually, several pulp qualities are produced in the fiberline, and campaign operation of the mill to alternate between softwood and hardwood pulp production is common in many mills.

In terms of pulp capacity the main difference between hardwood and softwood is that hardwood has a higher yield. This means that the black liquor dry solids per ton of pulp is higher for softwood than for hardwood, and consequently the required capacity of the chemical recovery line is greater for a softwood mill compared to a hardwood mill with the same pulp production capacity. Campaign production of softwood and hardwood maximizes utilization of the recovery boiler, and the total capital cost for the combined production is minimized. There are also some advantages in terms of the millwide energy and chemical balances with campaign operation.

In this report the pulp mill is considered to be a single line mill with a maximum continuous rate (MCR) of 2000 ADt/d when producing bleached softwood pulp and 2400 ADt/d when producing bleached hardwood pulp.

Some unbleached pulp, 300 ADt/d, is taken directly to the board machine, and the board machine also uses some purchased bleached chemi-thermochemical pulp (BCTMP). The board machine is designed to produce 600 000 tonnes of liquid packaging board per year.

Bleached pulp produced in excess of that needed by the board machine is dried and sold as market pulp.

Mass balances have been prepared for the reference mill for mill MCR (Maximum Continuous Rate) conditions to determine the capacity requirements for the main mill areas. The balances cover, e.g., wood, chemicals, black liquor dry solids and lime. Elemental mass balances have also been done for sodium and sulfur. Table 2-1 summarizes the key operating and dimensioning data for the integrated cartonboard reference mill during the softwood and birch campaigns, respectively.

Table 2-1. Summary of integrated board mill key operating data.

		Softwood campaign	Birch campaign
Finished kraft pulp production	ADt/d	2 000	2 400
Operating days	d/a	305	50
Mill availability	%	92	92
Annual production	ADt/a	561 441	110 111
Wood yard			
Roundwood with bark/Saw mill chips	%	70/30	100/0
Wood to digester	tDS/d	4 036	4 426
Bark and wood waste	tDS/d	396	594
Digester Plant			
Kappa number		30	17
Unscreened deknotted digester yield	%	47.0	51.0
Alkali charge on wood as effective alkali	NaOH, %	20.0	18.5
Sulfidity (white liquor)	mole-%	38	38
Oxygen Stage			
Kappa number after oxygen stage		12	11
Alkali charge as NaOH	kg/ADt	30	18
Oxygen charge	kg/ADt	20	14
Washing Department			
Dilution factor in the last stage	m ³ /ADt unbl.	2.5	2.5
Evaporation Plant			
Weak black liquor to evaporation, excl.spill	t/h	911	947
ditto dry solids content	%	16.0	15.6
Strong black liquor, dry solids content incl. ash	%	83	83
Total evaporation, including spill	t/h	776	818
Recovery Boiler			
Estimated higher heating value of virgin DS	MJ/kg	13.94	13.90
Strong liquor virgin solids to mixing tank	t/24 h	3 467	3 522
Net useful heat from liquor, virgin solids	MJ/kg DS	10.20	10.09
Net useful heat from liquor	MW	409	411
Causticizing and Lime Kiln			
Causticizing efficiency	mole-%	82	82
Total white liquor production	m ³ /24 h	7 626	7 657
Lime kiln load (as lime product)	t/24 h	515	517
Active CaO in lime	%	90	90

2.3 ENERGY SYSTEMS AND BALANCES

The reference mill is designed to be energy efficient. The mill would be self-sufficient in both power and steam with only internal fuels black liquor and bark. The mill has a power boiler to make use of surplus bark/wood waste and for potential sludge recovery. There is an excess of steam from the recovery and power boilers which is utilized in a condensing turbine to produce renewable power for export.

The lime kiln is fired with gasified bark, and the remaining bark from the woodyard and chip screening is co-fired with sludges from effluent treatment in the power boiler.

The balances are prepared at MCR campaign operation in the pulp mill and considering the design capacity of the board machine as gross paper production. The varying bark firing in the power boiler in each campaign is a result of the different wood supply concept for softwood and birch. However, the actual variation in steam generation could be reduced by mixing of bark stored in each campaign. The impact on recovery boiler steam generation is considered similar as to above.

Mill energy balances are expressed per tonne of liquid packaging board ("t-paper" in this report), which is the main product of the mill.

Table 2-1. Summary of steam and power balances for the 2024 reference mills. Balances are expressed per tonne of liquid packaging board, which is the main product of the mill.

	Softwood campaign	Birch campaign
STEAM BALANCE (GJ/t-paper)		
Generation		
Recovery boiler	17.25	17.33
Power boiler	1.59	3.68
H ₂ SO ₄ heat recovery	0.00	0.00
Secondary heat	0.57	0.71
Total steam generation	19.40	21.72
Consumption		
Process steam	11.51	12.43
Back pressure turbine	4.13	4.54
Condensing turbine	3.76	4.74
Total steam consumption	19.40	21.72
POWER BALANCE (kWh/t-paper)		
Generation		
Back pressure power	1 108	1 218
Condensing power	382	483
Total power generation	1 490	1 701
Consumption		
Mill consumption	1 069	1 136
Sold power	421	565
Total power consumption	1 490	1 701

The power boiler capacity for the birch campaign is mainly a result of selected wood supply, 100% roundwood for birch and 70% for softwood, but also accounting for differences in heating values and bark consumption in the lime kiln.

3 Process Description

3.1 WOOD SUPPLY

The softwood raw material consists of 50% pine (*Pinus sylvestris*) and 50% spruce (*Picea abies*). The relation between roundwood with bark and sawmill chips is 70% roundwood and 30% sawmill chips.

The birch is mainly *Betula spp.* with about 10% other hardwoods, mainly aspen. The supply is 100% as roundwood, with bark.

3.2 WOODYARD

The softwood and birch debarking is performed in dry debarking drums which are designed for a barking efficiency of 95%. There is a closed re-circulation of sprinkling and de-icing water. The de-icing water is heated by the means of heat exchanging with surplus hot water. The effluent is collected together with the press water from the bark presses in a sedimentation basin for re-circulation. The sludge from the sedimentation basin is burned in the power boiler.

A portion of the bark is utilized as fuel for the lime kiln; the rest is burned in the power boiler.

After debarking the logs are transported to a metal detector and a water stone trap. In the chipper, logs are cut to chips. Consistent chip thickness is important for uniform cooking and a low pins fraction is important for the runnability of the digester. The chips are therefore screened to get an optimal chip size. Accepted chips are transported to a chip silo. Over-thick, over-sized chips are taken to a re-chipper and then back to chip screening. Fines, about 0.5% of the chipped wood, are stored and burned in the power boiler.

3.3 DIGESTER

Either continuous or batch digesting can be used, and both alternatives have pros and cons. Continuous digesters are the dominant technology for both existing and new mills. Also, in general the batch processes, as marketed today have higher steam consumption than the continuous processes. Thus, the continuous cooking process has been selected for this study.

The Valmet Continuous Cooking concept, see Figure 1, is one example of a modern cooking system. Chips are pre-steamed and impregnated with white liquor and black liquor at atmospheric conditions in a vessel, and the cooking is performed at a relatively high alkalinity with co-current liquor flow at relatively low temperature. The cooking temperature is about 155°C for softwood, and 145°C for birch. Black liquor is extracted for evaporation from the impregnation vessel via liquor filters and is pumped to the evaporation plant.

Andritz DownFlow LoSolids cooking system with or without a pressurized impregnation vessel is another example of a modern cooking system.

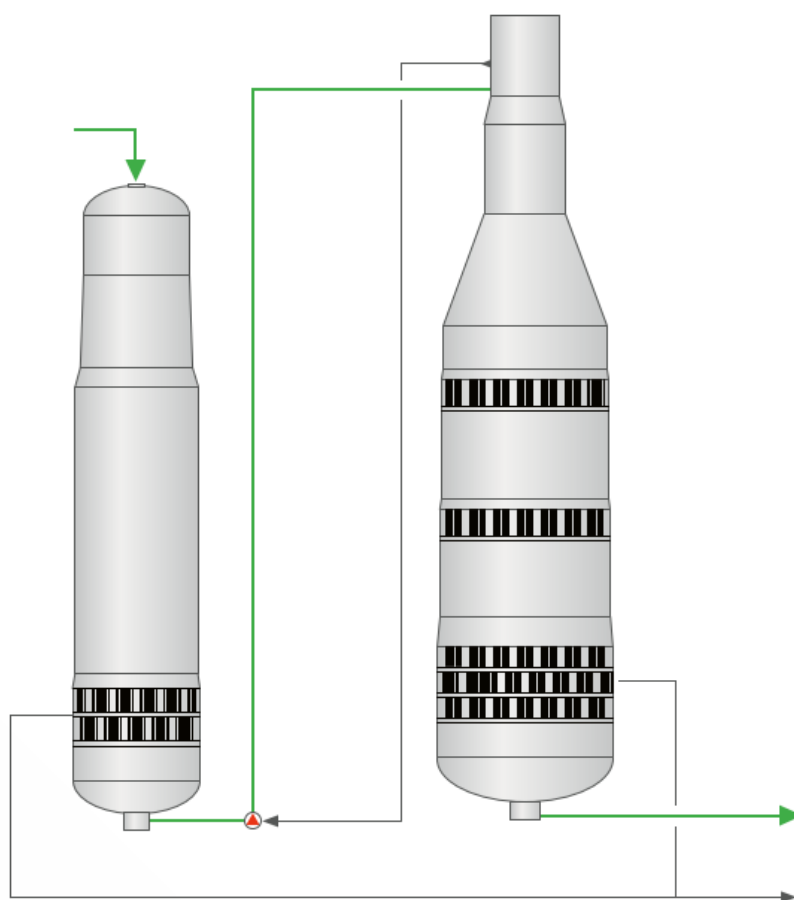


Figure 1. Example continuous cooking system (Valmet Continuous Cooking).

Table 3-1. Digester key figures.

		SW	Birch
Kappa number, digester blowline		30-32	17-18
Deknotted digester yield	%	47	51
White liquor AA concentration	NaOH, g/l	140	140
Alkali charge on wood as effective alkali	NaOH, %	20.0	18.5
Sulfidity, white liquor	%	38	38
Extracted turpentine	kg/ADt	2	0

In order to improve yield and fiber strength the kappa number after cooking could be increased by some units. This should however be balanced with the delignification in the oxygen stage.

3.4 BROWNSTOCK DEKNOTTING AND SCREENING

There are several important quality parameters for pulp. One of them is very high cleanliness, i.e. a low content of shives and colored spots originating from the pulpwood (resin and bark) as well as foreign materials such as sand, plastic, rubber and rust.

Pressurized deknottting separates knots from the pulp. After deknottting the pulp is screened at 3-4% consistency by barrier (slotted) screens in three or four stages. The knots are recooked. Screen rejects from the last screening stage can be refined and be returned to the process or taken to a screw press to be dewatered to about 30-40% consistency prior to a dumpster. The rejects from the dumpster are burned in the power boiler.

3.5 OXYGEN DELIGNIFICATION

Oxygen delignification is done in two stages without intermediate washing to a kappa number of 11-12 for softwood and 10-11 for birch. Oxidized white liquor is the primary alkali source. To optimize the delignification in the initial and final phases the reaction time is approximately 10-30 minutes in the 1st stage and approximately 60 minutes in the 2nd stage.

Table 3-2. Oxygen delignification key figures.

		SW	Birch
Kappa number after oxygen stage		11-12	10-11
Dissolved DS (yield losses)	%	3.8	1.6
MgSO ₄ charge		1-2	0-1
Alkali charge oxidized WL, as NaOH	kg/ADt O ₂	28-32	18
Oxygen charge	kg/ADt O ₂	20-22	14
Temperature first stage	°C	90 - 95	90 - 95
Temperature second stage	°C	95 - 100	95 - 100

3.6 PULP WASHING

The brown stock washing consists of:

- Two or three stages for softwood and birch. Either wash presses or drum displacement (DD) filters can be used.
- Post oxygen washing with one 2-stage DD washer before the oxygen bleached storage tower. Alternatively, two wash presses could be used. These wash presses may be placed after the oxygen blow tank (and before the unbleached storage tower) or, one of the presses could be located before the unbleached storage tower and one after (pre bleach press).

Figure 2 shows one alternative for brownstock washing.

The brownstock washing dilution factor is 2.5 m³/ADt.

The carryover of TOC from the oxygen delignification to the bleach plant is calculated to be approximately 3 kg TOC/ADt (corresponding to about 8-9 kg/ADt COD), excluding the TOC in bleach plant filtrate re-circulated to brown stock washing.

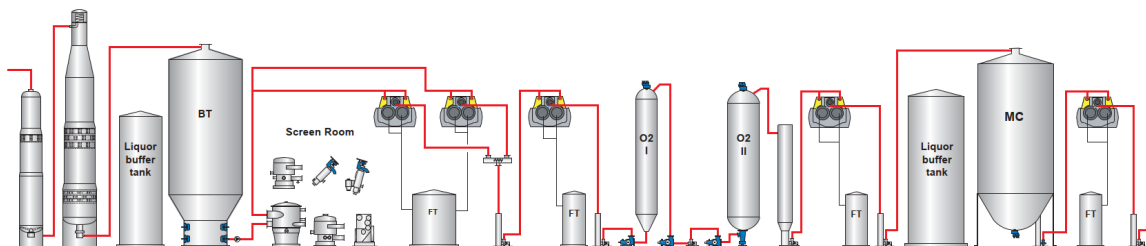


Figure 2. One example of a typical brownstock washing system (Valmet).

3.7 BLEACHING

The softwood and birch pulps are bleached to a final brightness of 90%.

The bleach plant is designed with three or four bleaching stages. For softwood pulp the first stage is operated as a “conventional” D-stage, and the sequence is D(EOP)DP. For birch pulp the first stage is operated as a D_{hot}-stage, and the sequence is D_{hot}(EOP)DP.

Wash presses or 1-stage DD washers are used for all washing in the bleach plant.

The main reason for selecting a hot first D stage for birch pulp is that a lower charge of ClO₂ is required to attain the required pulp brightness, and that less brightness reversion of the fully bleached pulp takes place. These benefits are, however, not attained on softwood pulps as they contain considerably less hexenuronic acids than birch pulp. Hexenuronic acids are effectively removed in D_{hot}-stages.

The last bleaching stage could be a D-stage instead of a P-stage. This is partly an economic decision which depends on the prices of chlorine dioxide, hydrogen peroxide and sodium hydroxide. A final P-stage in place of a final D-stage may also decrease brightness reversion.

The expected bleach plant chemical charges and conditions are summarized in Table 3-3 and Table 3-4.

For softwood the bleaching sequence results in a yield of 98%, which corresponds to a total yield of about 44% (including losses in cooking and oxygen delignification). For birch pulp the bleaching sequence results in a yield of about 97.5% and a total yield of about 49% for birch.

Table 3-3. Expected chemical charges for the SW kraft pulp with the sequence D(EOP)DP to 90%ISO brightness (kg/ADt). ClO₂ as ClO₂ and not as active Cl. Kappa number of pulp to bleaching: 12.

Stage	Temp (°C)	Time (min)	pH	ClO ₂	O ₂	H ₂ O ₂	NaOH	H ₂ SO ₄	NaHSO ₃
D	70	30-40	~2,5	9				4	
(EOP)	80-85	75-90	10.5-11		6	1	13		
D	75-80	120	3.5-4	5			1		0.5
P	75-80	120	~10			6	6	1.5 (a)	

(a) After P-stage

Table 3-4. Expected chemical charges for the birch kraft pulp with the sequence D_{hot}(EOP)DP to 90%ISO brightness (kg/ADt). ClO₂ as ClO₂ and not as active Cl. Kappa number of pulp to bleaching: 10.

Stage	Temp (°C)	Time (min)	pH	ClO ₂	O ₂	H ₂ O ₂	NaOH	H ₂ SO ₄	NaHSO ₃
D _{hot}	85-90	120	~3	7				6	
(EOP)	85-90	60	10.5-11		3	1	12		
D	75-80	120	3.5-4	5			1		0.5
P	75-80	120	~10			6	6	1.5 (a)	

(a) After P-stage

A high degree of system closure can create problems with scale formation within the bleach and evaporation plants, high bleaching chemical consumption, corrosion and plugging problems in the recovery boiler and problems controlling the Na/S balance of the mill. Bleach plant liquors must be handled in an optimal manner; for example, mixing should be performed within critical temperature and pH limits, where the risk for scaling is the lowest.

Based on experience a relatively conservative approach regarding system closure has been adopted to ensure sustained trouble-free operation with good economics.

The bleach plant is designed to release 8-15 t/ADt of effluent. This range includes an allowance for up to 5 t/ADt of fresh water. This extra intake of fresh water can be used for washing or dilution at any position in the bleach plant where there is a risk for precipitation. The extra intake of fresh water also makes it possible to bleed out metals and Cl⁻ ions.

Figure 3 shows the approximate liquor flows in the bleach plant for a D(EOP)DP bleaching sequence. White water from the pulp machine is used as dilution after the final bleaching stage washer and as wash liquor on the wash press after the final P-stage. The filtrate from this wash press is then used as wash liquor on the EOP-stage wash press. Hot water is used as wash liquor on the D1-stage wash press and condensate is used as wash liquor on the D0-stage press. The filtrate from the (EOP) wash press is then transferred as wash liquor to the 2nd wash press after the oxygen stage.

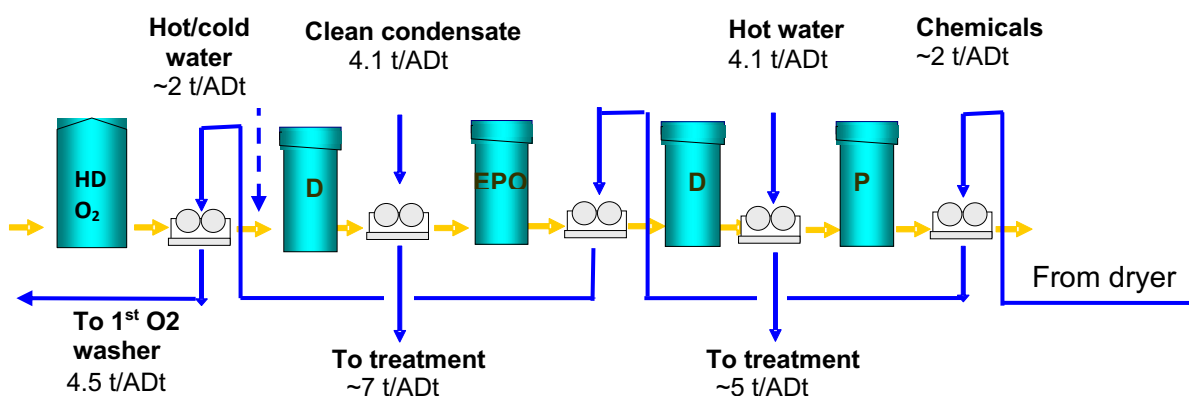


Figure 3. The approximate liquor flows (t/ADt) of the ECF bleach plant. The dilution factor is about 2 t/ADt.

One effect of bleach plant filtrate recycling is to almost eliminate all direct sodium make-up intake, as the sodium intake to the recovery cycle via EOP stage filtrate and chlorine dioxide plant by-product is more than that needed to cover the sodium losses of the mill.

One effect of the recycle of EOP and P stage effluents is that the mill bleach plant effluent will be significantly more acidic with an increased neutralization demand. To utilize the excess sodium available, oxidized white liquor is used for effluent neutralization. This also removes substantial amounts of chloride and potassium from the recovery cycle. Consequently, the capacity of the chloride removal process (CRP) can be minimized.

The overall sodium-sulfur balance for the pulp mill is shown in Appendix A and B.

3.8 BOARD MACHINE

3.8.1 Capacity & process concept

The capacity of the board machine is 600 000 t/a which is lower than the pulp mill production. The excess kraft pulp will be sold as market pulp.

The board machine is designed to produce liquid packaging board. A block flow diagram is shown in Figure 4.

The furnish composition is:

- Bleached softwood pulp 35%
- Unbleached softwood pulp 28%
- Bleached hardwood pulp 16%
- Bleached chemi-thermomechanical pulp 21%

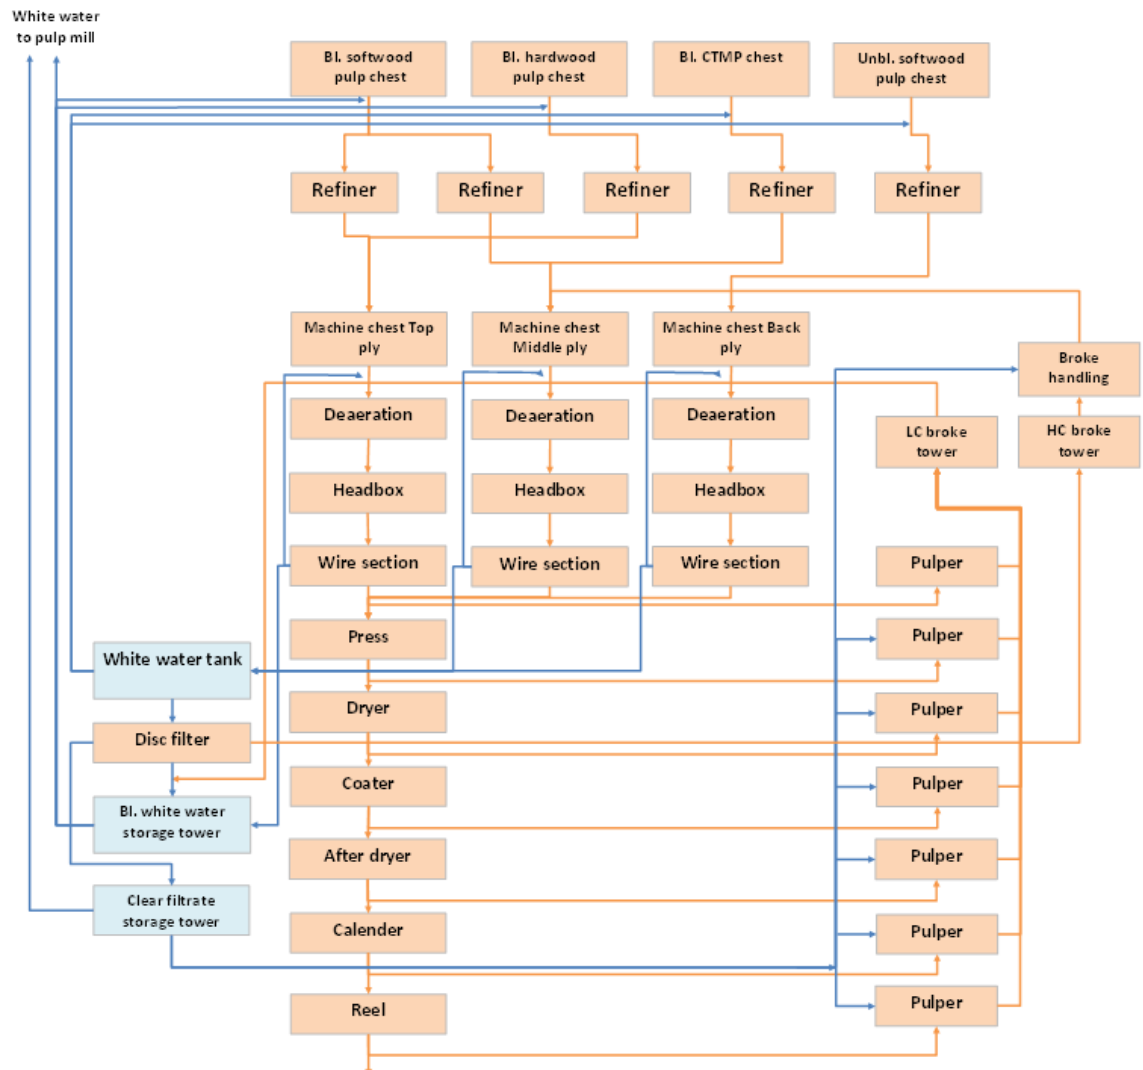


Figure 4 Process concept of the board machine.

3.8.2 Stock preparation

Kraft supply

The pulp mill produces softwood and hardwood in campaigns. There are MC-storage towers for each pulp type. Since there is not a perfect plug-flow through the pulp mill, there will be some intermediate pulp produced when changing from hardwood to softwood. This intermediate pulp is stored in a separate MC-tower. The optimal size and number of towers will depend on the product mix of the board machine and operational strategy. One important factor to take into account when dimensioning the storage towers are the potential problems with microbiological growth.

From the MC-storage towers, pulp is diluted and pumped to their respective pulp chest. From the pulp chests, the pulp is diluted and pumped via refiners to the hardwood and softwood dosing chests. In this mill hardwood and softwood are refined separately to optimize their properties. Intermediate pulp is pumped via

the hardwood refiner to the hardwood dosing chest. From the dosing chests, pulp is diluted and proportioned to a combined mixing and machine chest. These systems reduce the volume of pulp in the process and enables quicker quality changes.

Broke system

Broke from all the pulpers on the machine is pumped via the couch pit to the broke LC broke tower. The broke from the LC broke tower is thickened in a disc filter and pumped to a HC tower. Thickened pulp from the HC tower can be recycled to the LC tower if needed.

Broke, which is proportioned to the paper machine, is pumped via deflaking, screening and refining to the paper machine.

Pulp mixing and short circulation

Consistency is adjusted after the pulp mixing chest and the diluted pulp is cleaned and screened.

It is possible to reduce the power consumption by increasing the consistency in the hydrocyclone system in the short circulation. The short circulation consists of the wire silo, de-aeration equipment, fan pump, LC cleaners and machine screening.

Board machine

The forming section comprises a Fourdrinier section for each ply, total three and an on-top former for the middle ply having the highest production. The middle ply headbox is equipped with a dilution system for CD profile control. The middle ply wire section is equipped with a breast roll shaker to improve formation. The print ply is at the bottom.

The press section comprises a pick-up, two double felted shoe presses and top single felted shoe press smoothing press. A dryness of 42% after the press section has been used in dryer section dimensioning calculations.

The dryer section comprises a single and double tier pre-dryer section, film sizer, and a double-tier post dryer section including curl control.

The coater section is comprised of four stations, three for the top side and one for the reverse side. Dryers in the coating section are steam heated. After the coating section can the web be cooled with a cooler.

A center driven reel is included for good jumbo reel quality and large diameter. Jumbo reels are transferred from the reel to the winder using transfer rails with intermediate stations.

Main data for the board machine is presented in Table 3-5.

Table 3-5. Main data for board machine

Key data, board machine		
Speed, design	m/min	1 200
Speed, at pope	m/min	900
Width on pope	m	7,9
Grammage	g/m ²	190-270
Base ply	g/m ²	45-50
Middle ply	g/m ²	60-120
Top ply	g/m ²	65-70
Paper dryness	%	92
PM furnish composition, annual average		
BSKP	BDT/a	168 800
BHKP	BDT/a	75 700
BCTMP	BDT/a	99 100
UBSKP	BDT/a	132 000
Consumption daily max, momentary 100% efficiency		
BSKP	BDT/d	550
BHKP	BDT/d	400
BCTMP	BDT/d	440
UBSKP	BDT/d	480
Maximum gross production on pope	t ₉₂ /d	1 900
Material efficiency	%	90
Time efficiency	%	90
Speed efficiency	%	100
Available time	d/a	354
Annual paper production	t ₉₂ /year	600 000
Steam		
Annual consumption, LP steam	t/a	378 600
Annual consumption, MP steam	t/a	856 300
Power consumption		
Annual consumption	GWh/a	377
Max continuous	MW	50

3.8.3 Freshwater system

The warm water system is the main freshwater consumer in the paper mill. Warm water is mainly used for high pressure cleaning showers in the wire- and press sections and for dilution of different chemicals. The process related freshwater consumption is about 8 m³/t of paper. Warm water is received from the kraft mill. Used cooling waters and other uncontaminated process waters are collected separately and re-circulated via a cooling tower to the freshwater systems.

3.8.4 White water system and buffer volumes

The board machine white water system is split into bleached white water system for the top layer and unbleached white water systems for the other layers. Both systems have their own storage towers. Bleached white water is used for dissolving pulp and dilutions for the bleached pulp.

Unbleached white water is treated with the disc filter that is used for thickening of broke. Some superclear filtrate from the unbleached white water tower can be used for keeping the level in the bleached white water tower.

Accidental discharges are avoided with a dimensioning of broke, pulp and white water storage buffer volumes in balance, which means that the white water storage towers in the system should have a volume corresponding to the total sum of all pulp storage towers. It is important that the control philosophy of level control for the buffer towers is correctly designed as a white water tower which is always filled provides no buffer volume. A correct dimensioning and use of the storage buffer volumes also mean minimal variations in the flow of waste water to the external treatment plant which should result in higher treatment efficiency and lower investment and operation costs for the external treatment plant.

3.8.5 Energy aspects of the board machine

The main input of energy to the paper machines is steam for drying of the paper. About 3.15 GJ/t evaporated water is needed for drying. The efficiency of the paper machines (need for re-drying of broke) and the dryness of the paper after the press section are of great importance for the steam consumption. With a press dryness of 42%, a final dryness of 92%% and 20 g/m² coating, the heat consumption for drying is 3.81 GJ/t paper. Steam is also used for heating purposes on the paper machine. The air to the blow boxes must also be heated with steam. The total consumption of steam on the paper machine is about 4.21 GJ/t paper.

The total consumption of electric energy for the paper machine is about 550 kWh/t. The main part of this power consumption is in motors for vacuum system, pumps, screens, drives and refiners in the paper mill. Most of this energy is going into the process flow as thermal energy and contributes to keeping the system temperature on a high level. The desired level is somewhere in the range 40-50°C. A high temperature improves the dewatering on the wet end and minimizes bacteriological and slime problems but depending on which chemicals are used there will be an upper limit to the white water temperature.

On the wire section, the process water loses about 10 MW of heat to the surrounding air by evaporation. The high dryness of the pulp from the pulp mill means that only a small amount of thermal energy is transferred with the pulp from the pulp mill. To maintain the desired white water temperature, heat is transferred from the heat recovery system of the drying section to the paper machine white water

Table 3-6. Board machine energy consumption data

Dryness to dryer %	%	42
Paper dryness %	%	92
Evaporated	t/t paper	1,3
Heat consumption drying	GJ/t evap.	3,15
Heat consumption drying	GJ/t paper gross	3,81
Heat consumption miscellaneous	GJ/t paper gross	0,40
Total heat consumption paper mill	GJ/t paper gross	4,21
Power consumption incl. refining	kWh/t paper gross	566
Water consumption, daily	m ³ /t paper gross	7,55

3.9 PULP DRYER

3.9.1 Secondary screening, wet end and press section

The secondary screening plant included in the stock preparation is a pressure screen concept with slotted screen baskets in a cascade arrangement. The consistency is between 1.5% – 3.5% Secondary screening can either be between blend chest and machine chest or in short circulation. Last 2 or 3 recovery stages of secondary screening plant are with centrifugal cleaners. Pressure screens have proven to be able to produce pulp with a good cleanliness with low energy consumption. The screened pulp is diluted in the approach flow system to 1-2% consistency and fed to the hydraulic headbox. Typical system temperature in short circulation is about 65°C without any addition of steam. For optimum CD basis weight profile the headbox is equipped with an automatic CD dilution control system.

For efficient dewatering and short forming section length, either a twin wire configuration or a hybrid former which is a fourdrinier with a top wire is considered. At the end of forming section a steam box or hot water boxes are used for heating of sheet which improves dewatering in press section.

For efficient dewatering a combi-press followed by one or two double felted shoe presses is considered. In the first open draw, after the 2nd nip of combi press, the sheet has a dryness of above 40%. The shoe press gives a dryness into the dryer of 50-54% for pine and birch depending on specific production and number of shoe presses.

3.9.2 Dryer and heat recovery

The pulp dryer is of floating web type, which dries the pulp web while keeping it floating on a cushion of hot air heated by LP steam. One or two bottom decks are used to cool the dried pulp web to about 40 - 45 °C. Cooling reduces the brightness reversion of the pulp during storage and transportation.

Exhaust air from the pulp dryer goes through the heat recovery system where supply air to dryer, shower water and machine hall supply air are heated with energy in exhaust air. Also, dryer blow through steam and condensate are used for dryer supply air pre-heating.

3.9.3 Cutter-layboy and baling

The cutter-layboy handles the dry web from the pulp dryer. As the web passes through the slitting and cutting section it is slit and cut into bale size or wrapper size sheets. The sheets are conveyed to the layboy where they are formed into stacks on the layboy conveyor.

Three complete baling lines are required for a production of 4000 ADt/d. Bales are wrapped with pulp sheet or kraft paper and tied to an 8-bale shipping unit with a weight of 2 tons.

3.10 CHLORINE DIOXIDE GENERATION

The selection of the chlorine dioxide process (R8 or R10) is mainly based on the millwide sodium/sulfur balance. (R8 and R10 are the trade names from Erco. Nouryon has similar processes called SVP and SVP-SCW respectively.)

In both the R8 and R10 processes purchased sodium chlorate reacts with sulfuric acid, with methanol as the reducing agent, to produce chlorine dioxide and the by-product $\text{Na}_3\text{H}(\text{SO}_4)_2$. The R10 process however has an additional step where $\text{Na}_3\text{H}(\text{SO}_4)_2$ is split into Na_2SO_4 and H_2SO_4 , and the H_2SO_4 is returned to the ClO_2 generation process.

In the softwood mill the R8 process is selected. The $\text{Na}_3\text{H}(\text{SO}_4)_2$ by-product, is used to partially replace sulfuric acid used for soap splitting.

Since there is no soap splitting and an excess of sulfur in the birch mill the R10 process is selected to minimize the amount of excess sulfur (which is purged as recovery boiler precipitator ash).

3.11 OXYGEN SUPPLY

The oxygen demand of the oxygen delignification stage, EOP stage and other consumers is covered by oxygen generated on site in a Vacuum Pressurized Swing Adsorption (VPSA) plant.

At the capacity level required it is a simple and cost-efficient choice it can produce oxygen at up to 94% purity but does not provide a liquid oxygen back-up, so availability needs to be considered in the set-up, either by redundancy of key

components or liquid oxygen import facilities. The plant may be owned by the mill or by an over-the-fence supplier.

The VPSA process is simple. Incoming ambient air is filtered, compressed, and conveyed to one or multiple zeolite beds. In the zeolite bed the nitrogen of the air is adsorbed while the oxygen passes through to a product oxygen receiver. When the zeolite bed is saturated with nitrogen it is closed off from the product receiver and the pressure reduced to desorb the nitrogen. The desorption and evacuation of the nitrogen is aided by a vacuum pump.

A booster compressor after the oxygen receiver increases the oxygen pressure to meet downstream process demands.

The VPSA has a power consumption of 300 kWh/ton O₂(100%)

3.12 EVAPORATION

The evaporation plant is a conventional 7-effect system utilizing LP and MP steam (Figure 5). It is designed to produce 83 % dry solids liquor (including recovery boiler ash).

All evaporator bodies are of the falling-film type, and the seven effects are designed to operate in counter-current fashion, i.e. with live steam being fed to the first effect through the train via the seventh effect to the surface condenser.

The heat in the hot extraction weak liquor from the digester area is recovered in the evaporation plant by multiple flash stages down to a liquor temperature suitable for storage at atmospheric pressure. Weak liquor from the atmospheric storage is flashed in multiple stages and then processed counter-currently to the vapor from the seventh to the first effect. An alternative design to the strict counter-current operation is to feed the weak liquor to the fourth effect in a co-current sequence through the seventh effect before feeding the liquor to the third effect.

Storage tanks are installed for weak, intermediate and heavy black liquors well as for soap, spills and condensates. The firing liquor storage tank is pressurized due to the high dry solids content with high viscosity.

Ash mixing is done prior feeding the first effect. Firing liquor at 83 % DS is produced in the final body of the first effect liquor sequence. The first effect is divided into three bodies connected in series on the liquor side. Washing of the first effect is done one body at a time using weak black liquor. To avoid upsets in firing liquor concentration when washing, and to facilitate ash mixing, an atmospheric heavy black liquor storage tank is placed on an intermediate heavy liquor from the second body in the first effect liquor sequence. The liquor from this same tank is also utilized for ash pick-up and the liquor is then returned to the first body in the liquor sequence of the first effect. Hence, the dry solids concentration is deliberately increased to ensure operation above the critical dry solids, to force precipitation by sodium salts in the bulk liquor instead of on the heating surface. The ash particles in the bulk liquor acts as seeds for the primary nucleation of the sodium salts.

The final body operating with the strongest liquor in the first effect is heated by intermediate pressure steam from a steam ejector driven by MP steam to compress LP steam. The other bodies in the first effect are heated by LP steam only. The vapor from the final body with the strongest liquor in the first effect has a pressure sufficient for utilization as motive steam in a separate dedicated portion of the heating surface in the first body of the liquor sequence of the first effect; hence this vapor operates in eight effects steam economy.

Sludge from the biological treatment is mixed into the black liquor in an intermediate storage tank.

3.12.1 Handling of condensates

The evaporator bodies are designed for condensate segregation with one larger amount of clean condensate and one smaller of contaminated condensate. A stripping system for foul condensates is integrated heat-efficiently in the evaporation plant with cleaning vapor from the first effect and heat recovery in the second effect. A methanol rectification column with a turpentine decanter and foul methanol liquid storage is also integrated. The methanol is incinerated in the recovery boiler.

Evaporation condensates are divided depending on contamination degree and distributed to different consumers within the mill. Approximately 4.5 m³/ADt of the cleanest condensate (approximately 200 mg/l COD; 80°C) is used as wash liquor in the bleach plant. Approximately 3.5 m³/ADt intermediate condensate (approximately 1000 mg/l COD, 65°C) is used in the causticizing plant. The remaining condensate is also clean condensate and is discharged as effluent.

The surface condenser is designed for a warm water temperature of 50°C and to provide condensate segregation in the same principle as the evaporator bodies.

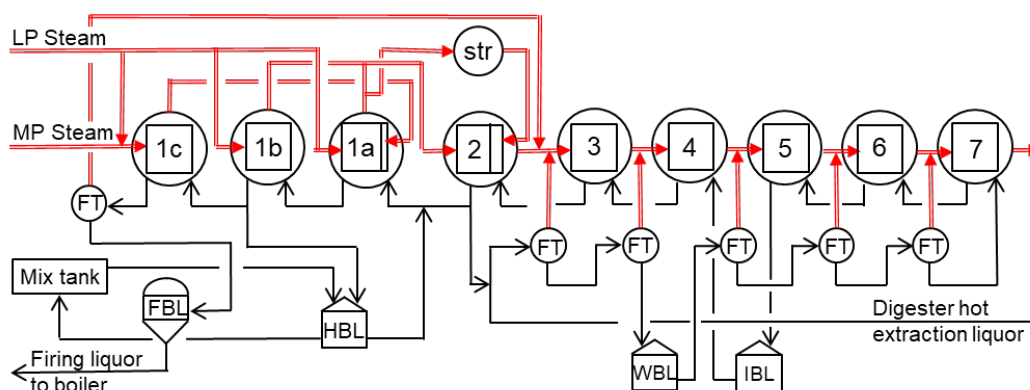


Figure 5. Evaporation plant including condensate stripper.

3.12.2 Handling of non-condensable gases

Non-condensable gases (NCGs) are collected throughout the mill. Both strong gases and weak gases can be burned in the recovery boiler. In mills which have a

large excess of sulfur, an alternative is to incinerate the gases in a dedicated boiler and recover the sulfur in the flue gas as sulfuric acid in a separate plant. This solution is not economically justified in the integrated cartonboard reference mill, which has a relatively small fiberline.

3.12.3 Tall oil recovery

Soap that separates in the weak and intermediate black liquor tanks is decanted to a soap decanter and then led to a separate storage tank. The soap is then pumped to the tall oil plant, where it is upgraded to crude tall oil. The amount of soap depends on the wood used for pulping. With 50% pine and 50% spruce, the tall oil production is assumed to be 35 kg/ADt for softwood. There is usually no soap separated from birch liquor.

The most common type of tall oil plant uses sulfuric acid for soap splitting, and sulfur is thus added to the recovery cycle. Mills that use an R8 process for chlorine dioxide generation can use the sodium sesquisulfate ($\text{Na}_3\text{H}(\text{SO}_4)_2$) by-product to partly replace H_2SO_4 that would otherwise have been used for soap splitting.

Some mills use carbon dioxide to pre-treat the soap. The product after this pre-treatment is a mixture of soap and tall oil (soap oil), and a water phase containing sodium bicarbonate. The water phase is separated from the soap oil, and then the soap oil is treated with sulfuric acid as in a traditional tall oil plant. Pretreatment with carbon dioxide however reduces the sulfuric acid requirement by about 40%.

3.13 RECOVERY BOILER

The optimum recovery boiler steam pressure and temperature is not the same in different regions. In Sweden many existing recovery boilers were designed when electricity prices were low. These boilers were in general designed for 60 bar steam pressure and corresponding temperatures. At higher steam temperatures more expensive metallurgy is required for the superheater, which means a sharp increase in investment and maintenance costs. Higher steam pressure and temperature cannot be economically justified with low electricity prices.

In contrast, Finland, for example, has had higher electricity prices, and the majority of recovery boilers operate at 80-90 bar. Globally, newer boilers are often designed for greater than 100 bar pressure to maximize power generation. With increasing electricity prices several new recovery boilers in Sweden have been designed for higher steam pressure and temperature.

In this study the recovery boiler is designed to produce high pressure steam at 110 bar(g) and 515°C. The selected steam data is currently at a limit for what is possible with existing materials and process chemistry in furnace. Because of these limitations it is unlikely that design pressure and temperature will increase substantially in the near future.

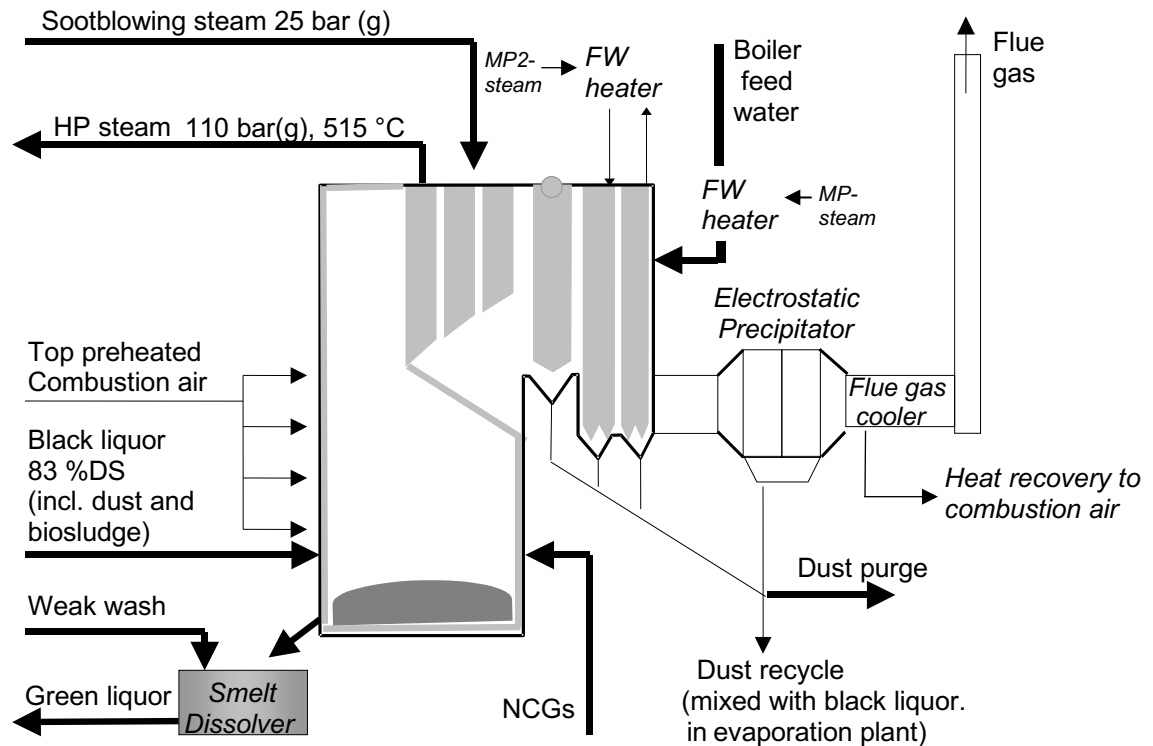


Figure 6. Recovery boiler and smelt dissolver.

Some of the key factors in the recovery boiler design which are related to maximizing power generation include:

- Feedwater preheating with both MP and MP2-steam, which increases steam generation and consequently the power generation. MP-steam is used for preheating before the economizer and MP2-steam as interheating after the first economizer step. The pressure (and temperature) in the feedwater tank is maximized and restricted by the pressure in the LP-steam system. One drawback of feedwater preheating is increased flue gas temperature after the economizer which increases the flue gas loss and increases the cost of the precipitator. In order to maximize power generation, MP-steam is prioritized for feedwater preheating.
- Flue gas cooling after the precipitator – the heat uptake in the cooler will commonly replace LP steam for combustion air preheating. Any surplus heat from the flue gas cooling circuit, exceeding heat consumption for air preheating, is utilized for demineralized water preheating. The LP steam can instead be sent to a condensing turbine to produce power. This also reduces the negative impact of increased flue gas temperature due to feedwater preheating. Flue gas temperature after the cooler is set to 125°C.

- Preheating of all combustion air to about 205°C to increase power generation. In order to maximize power generation, MP-steam is prioritized for air preheating prior MP2-steam.
- Sootblowing steam at 25 bar(g) is extracted from the turbine instead of using high pressure steam from the recovery boiler. Lower pressure for sootblowing has at present not been commercialized at large scale. Soot blowing steam consumption is minimized through operational adjustments, for example one way soot blowing.

The high liquor concentration contributes to a high bed temperature, which leads to low sulfur emissions from the bed. Modern boilers with high energy features often have black liquor concentrations of 82% DS (virgin). Going beyond this point increases steam production but may also lead to more difficult operation.

Combustion air is distributed on multiple levels to facilitate complete combustion and minimize NO_x formation. Dust that is not captured in the economizer section is removed in the electrostatic precipitator (ESP). Most of the dust is recycled and mixed with the black liquor in the evaporation plant, as described in section 3.12. A fraction of the dust is purged, mainly to control sulfur and sodium, with the additional benefit of reducing potassium and chloride concentrations in the liquor cycle.

With increased recovery boiler temperature and pressure, the tolerance for potassium and chloride in the black liquor is reduced. At the design pressure and temperatures for this boiler the maximum chloride concentration in the liquor is about 0.3 wt% and about 1.5 wt% for potassium. Exceeding these concentrations increases the risk for recovery boiler corrosion and plugging problems.

Softwood and birch have relatively low levels of chloride and potassium, but the recycling of EOP filtrate increases chloride levels in the black liquor. A large purge of recovery boiler ash would be required to manage the chloride and potassium, and the cost for makeup chemicals would be high. A chloride removal system to treat recovery boiler ash has thus been included. Either an ash leaching process, or an evaporative crystallizer process can be used for chloride removal.

3.14 CAUSTICIZING

The green liquor is filtered in parallel green liquor filter units. Alternatively, the green liquor can be clarified in a high-rate clarifier. The dregs are washed and dewatered in two decanter centrifuges in series before being discharged. Condensate from the evaporation plant is used for dregs washing. Dregs and grits are combined and sent to landfill.

Green liquor from the storage tank is cooled in a flash-type green liquor cooler before the lime slaker-classifier. Slaking and causticizing is performed in a single line with causticizing vessels in series.

The causticized liquor is filtered in a pressure disc filter. The main advantage of disc filters over other types of white liquor filters is the low liquor content of the

discharged lime mud which eliminates the need for a separate lime mud washing stage.

Lime mud from the lime mud vessel is pumped to the agitated lime mud storage tanks. The lime mud is washed and dewatered on a lime mud disc filter. Condensate from the evaporation plant is used for lime mud dilution and hot water for the lime mud filter wash showers.

Spills are reclaimed from two spill sumps and pumped to the weak wash storage tank.

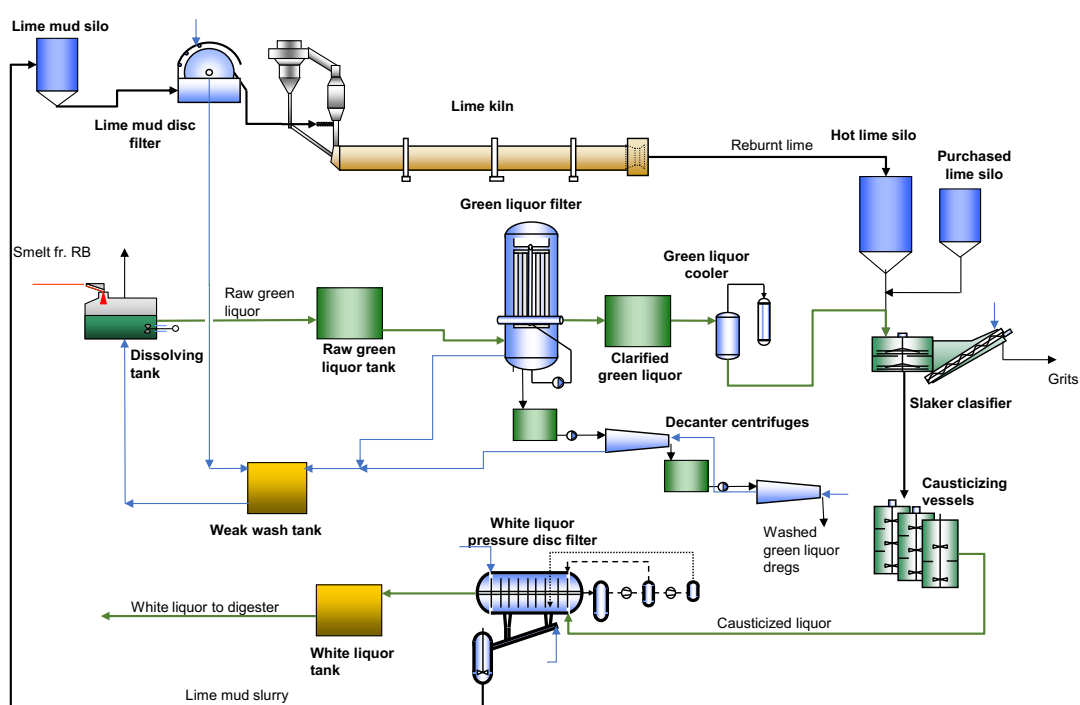


Figure 7. White liquor preparation.

3.15 LIME KILN

The single lime kiln is equipped with an external lime mud dryer and a modern product cooler. The product cooler could be of a rotary type mounted on the kiln or a moving grate cooler which provides a somewhat higher air temperature to the kiln and a steeper temperature profile in the kiln.

Dust is removed from the flue gases by means of an electrostatic precipitator. The ID fan is installed downstream the precipitator.

A fraction of the lime mud is purged and used for external purposes, primarily to control phosphate levels. Limestone or lime is used for make-up.

The kiln is fired with gas from a biomass gasifier fed with dried bark and wood residues. The bark dryer uses mainly heat recovered from the lime kiln flue gases over a pressurized hot water loop. The lime kiln heat recovery unit is placed after

the electrostatic precipitator and is of coiled tube type for high heat transfer capacity.

The gasifier design is a circulating fluidized bed (CFB) with limestone as the bed material (Figure 8). The temperature in the gasifier is 750-850°C.

The system consists of the gasifier, a cyclone to separate the circulating bed material from the gas, and a return pipe for returning the circulating material to the bottom part of the gasifier. The gasification air, blown with the high-pressure air fan, is fed to the bottom of the reactor via an air distribution grid. When the gasification air enters the gasifier below the solid bed, the gas velocity is high enough to fluidize the particles in the bed.

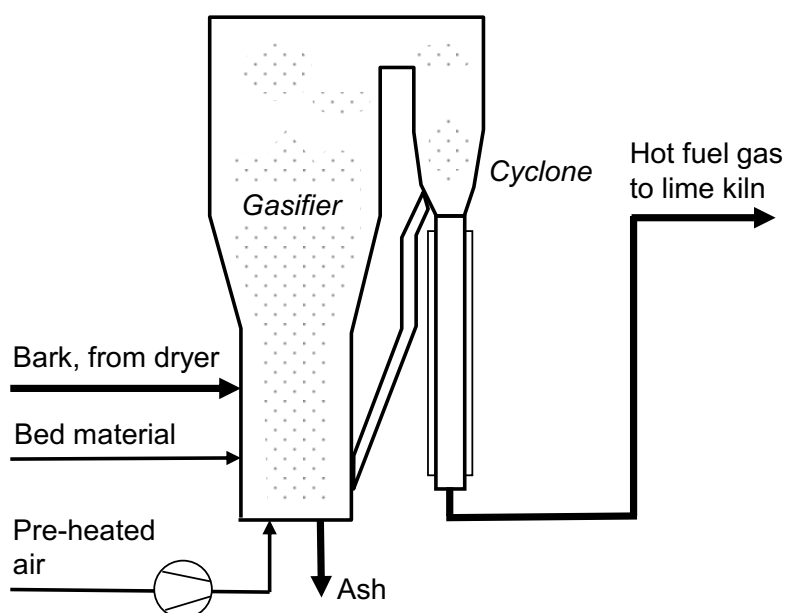


Figure 8. Bark gasifier for production of fuel gas to lime kiln.

The fuel gas is transferred at a temperature of approximately 700°C to the lime kiln burner. Slightly less than half of the falling bark is fed to the bark gasifier, corresponding to ca 6.5 GJ/t lime produced.

An alternative is to fire the kiln with wood powder, a solution used in several Swedish mills. Recent installations in large market pulp mills in Finland and globally have mainly been gasifiers [6], at least partly because a large amount of bark otherwise needs to be sold. In large installations the higher investment cost of a gasifier is thus more easily justified. Tall oil pitch is currently the most common biofuel used in lime kilns in Sweden, and to some extent in Finland, but is limited in availability.

3.16 POWER BOILER

The recovery boiler alone produces more than enough steam for the processes and power generation. However, since bark is readily available, even after feeding fuel for the lime kiln, a power boiler is included to produce additional HP steam. All excess steam is used in a condensing steam turbine to generate power for sale. Whether this is economically attractive depends on electricity prices in the location of the mill.

The power boiler has the same steam parameters as the recovery boiler and is connected to the common feed water tank.

Primary sludge from the effluent treatment plant is also incinerated in the power boiler. The boiler can, in certain circumstances, be designed to allow incineration of all sludge qualities from effluent treatment.

The power boiler is designed to provide steam for mill start-up and shutdowns, and there is no need for an additional boiler dedicated for start-ups and shutdowns.

The power boiler is designed with a bubbling fluidized bed (BFB).

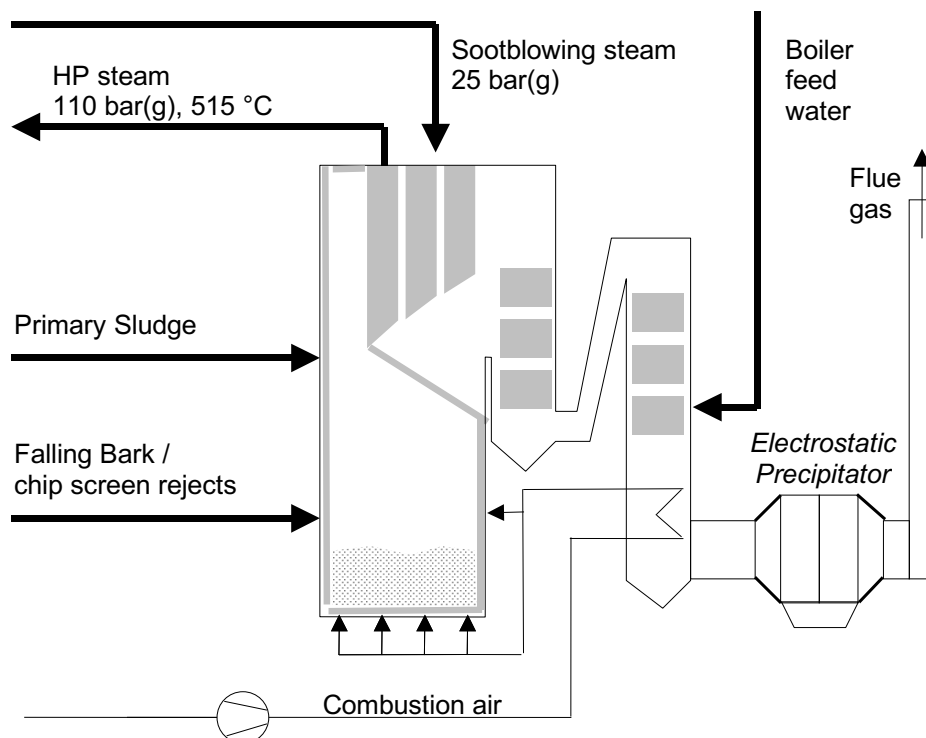


Figure 9. Power boiler burning bark and sludge.

3.17 STEAM TURBINES AND STEAM DISTRIBUTION

Steam is reduced through a backpressure steam turbine to 3.0 bar(g). This pressure has been selected to facilitate maximum electric power production without

requiring unnecessary large evaporator bodies or heat surfaces in the pulp dryer. Intermediate pressure steam of 25 bar(g) is extracted for soot blowing and 9 bar(g) steam is extracted to the MP-steam system.

MP steam and LP steam are desuperheated with boiler feedwater before distribution. However, with increasing turbogenerator efficiencies and selected steam parameters, the foreseen de-superheating requirement are low or zero. Provisions in steam distribution system for long term operation in or close to wet steam region is considered.

HP steam not required in the process is utilized in a condensing steam turbine for further electric power generation.

Table 3-5. Steam data.

	°C	bar(g)
HP steam	515	110.0
MP2 steam, extracted for sootblowing and preheating	275	25.0
MP steam, desuperheated	195	9.0
LP steam, desuperheated	144	3.0

3.18 COOLING AND RECOVERY OF LOW-TEMPERATURE HEAT

In addition to normal heat losses of different kinds, approximately one third of all the energy that is introduced with the fuel to the system will have to be cooled away by a cooling system. The secondary energy system comprises the recovery of heat that is generated from steam and electricity and that is finally withdrawn from the system by cooling. In principle, the system can be divided into two parts: one where heat is recovered for the production of warm and hot water, another part where excess heat is cooled by the means of a cooling tower. The design of the reference mill is conventional, except for the low fresh water consumption.

Low-temperature heat is recovered from a number of sources in the kraft mill, e.g., the surface condenser of the evaporation plant, the smelt dissolver vapor condenser, and the turpentine condenser. The heat is used for hot water production and for boiler feed-water heating. Condensate from the evaporation plant is used in the pulp washing and in the lime mud wash.

The cooling water system is integrated with the process water system. Cooling is carried out in cooling towers.

It is common for pulp and paper mills in the Nordic countries to sell excess heat to district heating systems, especially if the mill is located close to a town or city. Such solutions are efficient both because they reduce the amount of primary energy needed to supply heat to the district heating system and the amount of cooling that is needed in the mill. Integration with district heating or other users of excess heat has not been included in the reference mill, however, since the optimal solution will vary greatly between locations.

3.19 EFFLUENT TREATMENT

Effluent treatment consists of pre-treatment (cooling equipment and neutralization), primary clarification and biological (secondary) treatment. To meet the discharge limits for all parameters some polishing stage might also be needed. A block diagram is shown in Figure 10.

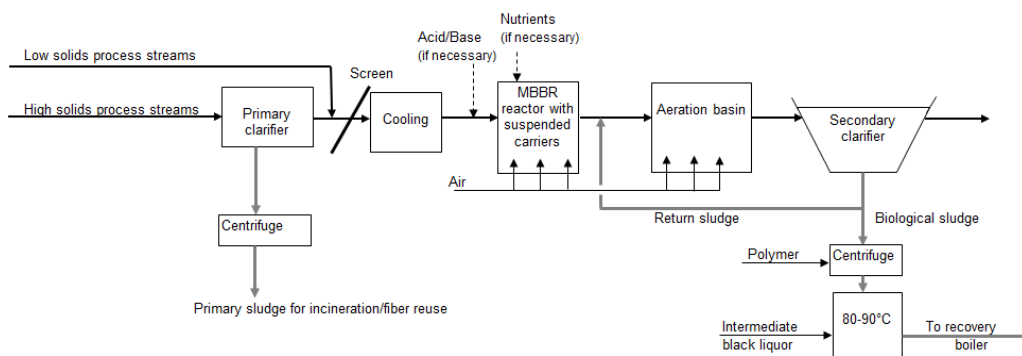


Figure 10 Effluent treatment plant

There is a primary clarifier to remove fiber sludge from high solids effluent. Effluent from the coating process is pretreated separately to remove suspended solids in this stream ahead of the primary clarifier. The estimated suspended solids content of the high solids process streams from the integrated cartonboard mill is about 450 mg/l. After the primary clarifier the suspended solids content is about 70 mg/l. The primary sludge is dewatered in a centrifuge and incinerated in the power boiler (alternatively the primary sludge could be sold to a fluting mill or similar, depending on the cost efficiency). After the primary clarifier the effluent is mixed with low solids effluent, screened, cooled to about 35°C, and the pH is adjusted to about 7.

Table 3-6. Outlet from primary clarifier and pre-treatment. Specific figures refer to cartonboard plus market softwood pulp.

		Cartonboard mill and SW market pulp
Flow from primary clarifier	m ³ /d	28 000
Total flow	m ³ /d	53 000
COD, total production	kg/t product *	24
	kg/d	60 000
SS, total production	kg/t product *	1.2
	mg/l	60
	kg/d	3 100
Temperature	°C	~35
pH		~7
Primary sludge	t DS/d	11

*Total production of cartonboard (600 000 t/year) plus market pulp (290 000 t/year)

For biological treatment there is an MBBR (Moving Bed Biofilm Reactor) reactor with suspended carriers followed by an activated sludge system, often called BAS (Biofilm + Activated Sludge). In the activated sludge system, there is an aeration basin and a secondary clarifier. Return sludge is pumped from the clarifier to the inlet of the aeration basin to keep a high level of activated sludge (microorganisms) in the basin. The system is designed for low biosludge production and low nutrient discharges. The COD reduction is estimated to be about 65-70% for softwood market pulp production and about 70-75% for the cardboard mill production.

The suspended solids concentration out from the secondary clarifier (BAS system) is about 50 mg/l for the integrated cartonboard mill.

The biological sludge is dewatered to about 10% in a centrifuge and mixed with intermediate black liquor in the evaporation plant, before incineration in the recovery boiler.

For some receiving waters higher demands than the lower level of the BAT-AEL ranges can be demanded for some parameters. This can be hard to fulfil without a final filter or other polishing stage.

The discharge values after biological treatment to the recipient are shown in Table 3-9.

The biological sludge production factor is estimated at 0.15 kg/kg COD reduced.

Table 3-7. Outlet data from biological effluent treatment at normal production.

		Cardboard mill and SW market pulp
Flow	m ³ /t products*	21
	m ³ /d	53 000
COD reduction BAS	%	70-75
COD out BAS	kg/t products*	~7-8
	t/d	18-20
TSS out BAS	kg/t products*	1.7
	mg/l	50
	t/d	1-3
Biological sludge	t/d	~6-8

* Total production of cartonboard (600 000 t/year) plus market pulp (290 000 t/year)

There are European BAT-AEL limits for discharges from pulp and paper mills. Those limits are expressed as intervals of discharge per ton of product for different types of production. The values are given in Table 3-9. For modern mills the lower part of the interval must normally be reached.

To reach very low nutrient discharges when high COD reduction rates are demanded is a challenge.

Table 3-9. BAT-AEL for effluent to recipient from bleached Kraft pulp mills and paper mills.

		Bleached Kraft Pulp	Paper mill
Flow	m ³ /t	25-50 ¹⁾	3.5-20 ¹⁾
COD	kg/t	7-20	0.15-1.5
Total suspended solids	kg/t	0.3-1.5	0.02-0.35
Total nitrogen	kg/t	0.05-0.25	0.01-0.1
Total phosphorus	kg/d	0.01-0.03	0.003-0.012
AOX, adsorbable organic bound halogens	kg/t	0-0.2	0.05 ²⁾

1) The flow values are not BAT-AEL values

2) For wetproof paper

3.20 SPILL HANDLING SYSTEM

Accidental spills caused by abnormal operation or equipment failures can be a significant contribution to the effluent emissions from the mill, and therefore it is important to minimize spills.

The mills are designed with comprehensive sewer systems to collect accidental spills as close to the source as possible and directly recycle them to the proper process stage. The evaporation plant is designed with additional capacity to take

care of black liquor spills in that area, as well as possible liquor contaminated condensates.

The spill system includes:

- Adequate instrumentation to minimize the risk for overflow of tanks and equipment, and to detect accidental spills.
- Provisions to take care of process liquors when it is necessary to empty tanks or equipment for maintenance
- Retention dams around tanks and equipment.
- Floor channels connected to pump sumps from which liquids can be pumped back to the process.
- Emergency effluent treatment pond for major spills or upset conditions in the effluent treatment plant.
- Well-educated and trained personnel who understand the importance of spill handling.

3.21 WATER SUPPLY AND TREATMENT

Water is commonly used for two main purposes in the mill: process water and cooling. Other areas of use are fire water and maintenance.

The raw water quality is normally high in Nordic rivers, with low content of suspended solids and chemical pollutants. There are however seasonal and interannual variations to be considered, as well as change in raw water quality as a consequence of climate change.

The mill water system has only one quality, chemically treated water, with the following treatment sequence (Figure 11):

- Water intake with coarse screening
- Reduction of fine suspended solids using mesh filtration
- Chemical precipitation followed by dissolved air flotation (DAF)
- Sand filtration
- Clear water well, including storage capacity for fire fighting

Table 3-8. Data, raw water treatment.

Flow	m ³ /d	50 000 – 70 000
Raw water sludge	kg/d	~3 000

The raw water intake should be arranged and designed to minimize the amount of sand and other debris entering the mill.

As precipitation chemical some kind of Al-salt is used and pH adjusted to an optimum using NaOH. To enhance flocculation properties a polymer is added.

Raw water sludge is discharged to the receiving water together with treated effluent.

Part of the chemically treated water is further treated to feedwater to be used in the recovery boiler and the power boiler. The demineralized water treatment plant comprises ultra filtration, reverse osmosis and ion exchange. Dosage of sodium hypochlorite, sodium bisulfite, sodium hydroxide antiscalant and biocide is foreseen. The plant is designed for a flow of 8 000 m³/d.

The cooling water system is semi-open, which means that part of the process water comes from the cooling water system. The cooling is performed in a cooling tower. There are filters in the cooling water system to avoid impurities in the mill process water.

The amount of process water coming from the cooling system is controlled so that the cold water temperature is maintained at about 18°C.

There is a separate cooling water loop for the turbine and the turbine condenser. The water from the turbine oil cooler is dumped. Other coolers in the mill are connected to the general mill process water system. Water from such coolers that could contaminate the water should also be dumped.

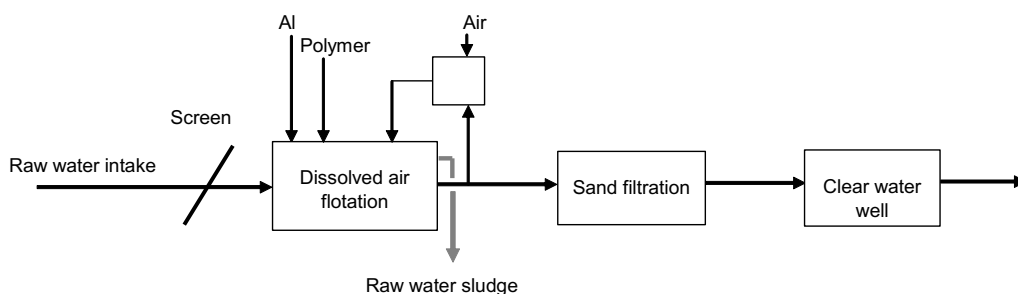


Figure 11. Water treatment sequence.

4 Reference mills - energy balances

The reference mills are designed to be energy efficient. The mills would be self-sufficient in both power and steam with only the recovery boiler and back pressure turbine. However, the mills have a power boiler to make use of surplus bark/wood waste and for sludge recovery, which increases the generated and sold power.

The lime kiln is fired with gasified bark, and the remaining bark from the woodyard and chip screening is co-fired with potential sludges from effluent treatment in the power boiler.

There is an excess of steam from the recovery and power boilers which is utilized in a condensing turbine to produce renewable power for export.

Key factors which make the reference mill energy efficient include:

- High HP steam data 110 bar(g), 515°C
- Feed water preheating to 175°C with MP-steam and interheating with MP2-steam to increase HP steam generation
- Recovery boiler flue gas cooler to replace LP steam consumed in air preheating
- Top preheating of all recovery boiler combustion air to 205°C
- Recovery boiler sootblowing steam is extracted at 25 bar(g) from the turbine instead of using HP steam
- Latest technology for pulp digesting which has a lower cooking temperature than other systems
- 7 effect evaporation plant with hot feed of weak black liquor; "hot liquor flash"
- Steam consumption in the bleach plant is reduced; more chlorine dioxide and less hydrogen peroxide allow a lower bleaching temperature
- Shoe press system in pulp dryer
- Low pressure steam used in the pulp dryer
- High share of LP-steam in total steam supply to board machine
- Pressurized condensate system
- High temperature of hot water, >85°C, and maximum use of hot water instead of steam in the bleach plant and pulp machine
- Bark press for bark to the power boiler

Depending on electricity prices there are some mills which have had more focus on design with lower total power consumption to reduce the amount of purchased power required (or maximize sold power).

An overview of the energy system and balances for the reference mill is shown in Figure 12 and Figure 13. More detailed balances can be found in Appendix C-G.

Mill energy balances are expressed per tonne of liquid packaging board (“t-paper” in this report), which is the main product of the mill.

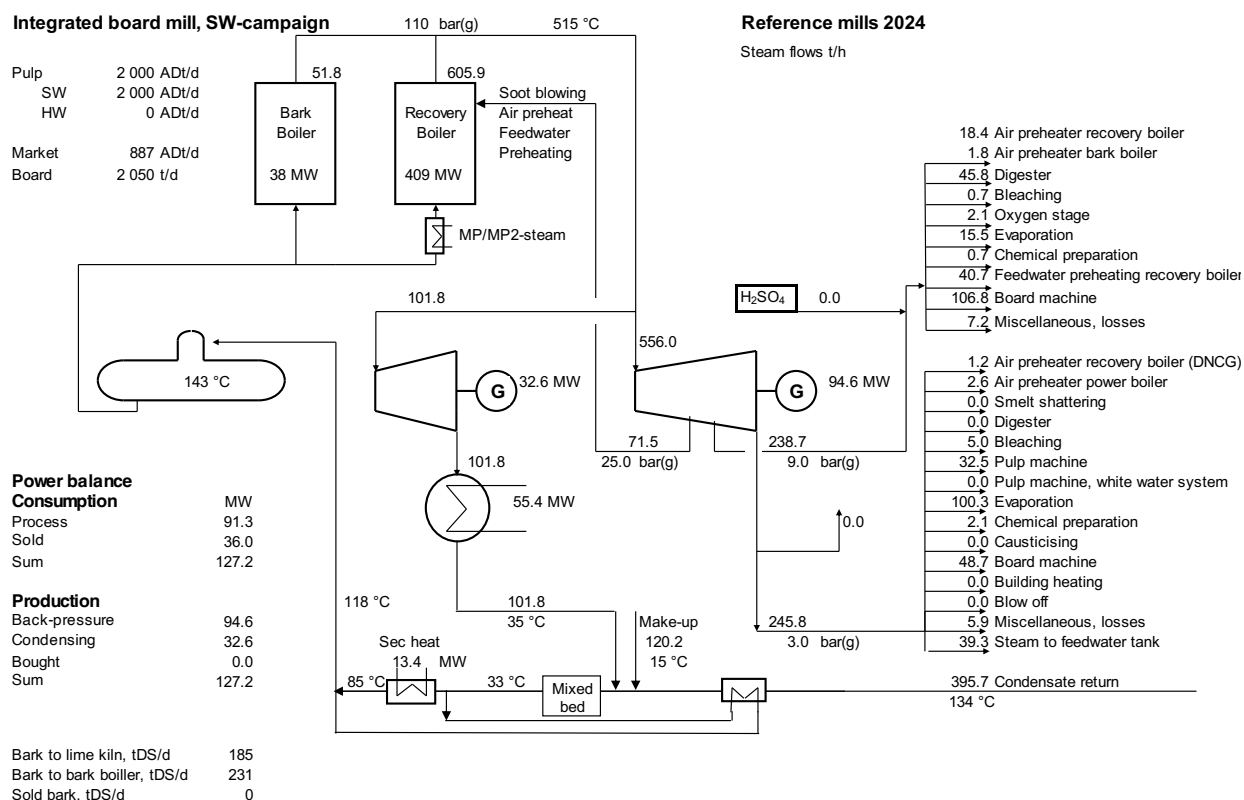


Figure 12. Overall energy balance for the integrated reference board mill at softwood campaign.

The process steam consumption in the integrated reference board mill at softwood campaign is about 11.5 GJ/t-paper. Heat generated from black liquor and falling bark amounts to about 17.3 GJ/t-paper (409 MW) and there is thus a large excess of steam that is used for electricity generation.

About 80% of the generated steam passes the back-pressure turbine to produce nearly 95 MW of electric power. The remaining steam is fed to the condensing turbine, which generates approximately 33 MW. Power consumption in the process is ca 91 MW. There is thus a potential to sell 36 MW, corresponding to more than 0.42 MWh/t-paper.

Process steam consumption at the birch campaign is slightly higher, ca 12.4 GJ/t-paper, mainly because of the selected division of market pulp and board production. Per ton of pulp, the specific process consumption is lower for birch which is due to the fact that the yield is higher than for softwood, resulting in less black liquor and a smaller evaporation demand.

The selected mill capacity results in approximately equal load on the recovery boiler in both softwood and birch campaigns. The total steam generation in the mill is however affected by the fact that there is more bark available in the birch mill. This is an indirect effect of the use of saw mill chips as part of the feedstock in the softwood mill, giving less falling bark in that case. Power consumption at the birch campaign is ca 97 MW. There is a potential to sell 48 MW, corresponding to ca 0.56 MWh/t-paper.

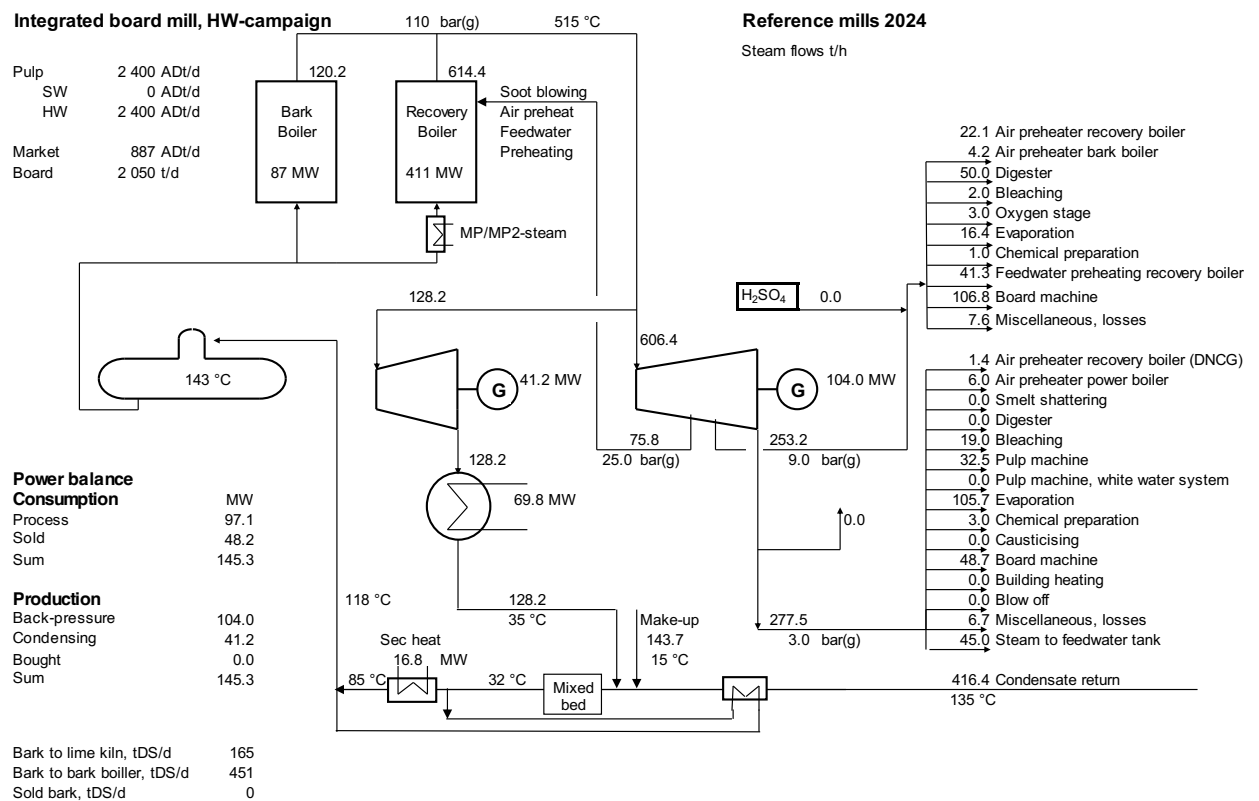


Table 4-1 presents the overall steam and power balances for the 2024 integrated reference board mill.

The mill is self-sufficient in steam and power using only the internal fuels black liquor and bark.

Table 4-1. Summary of steam and power balances in the 2024 integrated board reference mill. Mill energy balances are expressed per tonne of liquid packaging board ("t-paper"), which is the main product of the mill.

	2024	
	Softwood campaign	Birch campaign
STEAM BALANCE (GJ/t-paper)		
Production		
Recovery boiler	17.25	17.33
Power boiler	1.59	3.68
Secondary heat	0.57	0.71
Total steam generation	19.40	21.72
Consumption		
Process steam	11.51	12.43
Back pressure turbine	4.13	4.54
Condensing turbine	3.76	4.74
Total steam consumption	19.40	21.72
POWER BALANCE (kWh/t-paper)		
Generation		
Back pressure power	1 108	1 218
Condensing power	382	483
Total power generation	1 490	1 701
Consumption		
Mill consumption	1 069	1 136
Sold power	421	565
Total power consumption	1 490	1 701

5 References

1. Anonymous, STU-information Nr 730:1989, "Energi från skogsindustrin"
2. Jönsson T, Axegård P, Ledung L, "Reference Mill for the Ecocyclic Pulp Mill Program", KAM Report nr B25, Swedish Pulp and Paper Research Institute (STFI), Stockholm, November, 1998 (in Swedish).
3. Delin L, Berglin N, Lundström A, Samuelsson Å, Backlund B, Sivard Å, "Bleached market kraft pulp mill – Reference and type mill." FRAM report no 9, STFI-Packforsk, Stockholm, 2005.
4. ÅF Engineering, "Energy consumption in the pulp and paper industry - Model mills 2010: Bleached kraft market pulp mill", ÅForsk Reference: 09-163
5. Berglin N, Lovell A, Delin L, Törmälä J, "The 2010 Reference Mill for Kraft Market Pulp", 2011 PEERS Conference, Portland, Oregon.
6. Berglin N, von Schenck A, "Biofuels In Lime Kilns - Operating experience in the Nordic pulp and paper industry", Energiforsk report 2022:847.
7. EU Commission, "Implementing decision establishing the best available techniques (BAT) conclusions, under Directive 2010/75/EU of the European Parliament and of the Council, for the production of pulp, paper and board", 26 September, 2014.
8. Wiberg, R "Energiförbrukning i massa- och pappersindustrin 2011", Skogsindustriernas miljö- och energikommitté, 2011

Appendix A. Sulfur balance for the liquor cycle in the pulp mill of the integrated cartonboard reference mill during softwood and hardwood campaigns (kg/ADt).

	Softwood BSKP	Softwood UBSKP	Birch
Inorganics in the raw material	0.16	0.15	0.15
Make up as Na ₂ SO ₄	0.00	1.27	0.00
Make up as MgSO ₄	0.63	0.00	0.27
Waste product from ClO ₂ -plant	4.62		2.97
Waste product from tall oil plant	0.96	0.96	
External liquor supply	0.18		0.16
TOTAL IN	6.55	2.38	3.55
Wash loss	0.70	0.79	0.69
Unspecified losses black liquor	0.16	0.16	0.16
Unspecified losses white liquor and ox white liquor to effluent	0.16	0.16	0.16
Digester and evap. condensate	0.00	0.00	0.00
Dregs and grits	0.20	0.20	0.20
Sewered from CRP	0.00	0.69	0.77
Purged precipitator dust	4.93		1.22
Emitted from weak gas system			
Diffuse Emissions	0.10	0.10	0.10
H ₂ S from Recovery Boiler	0.01	0.01	0.01
Emission (SO ₂) from recovery boiler	0.20	0.18	0.16
Emission (dust) from recovery boiler	0.06	0.06	0.05
Dust from smelt dissolver	0.01	0.01	0.01
Emission from lime kiln, SO ₂	0.00	0.00	0.00
Emission from lime kiln, H ₂ S	0.01	0.01	0.01
Emission from lime kiln, dust	0.00	0.00	0.00
Dust from lime kiln scrubber/filter	0.00	0.00	0.00
Emission from NCG incinerator, SO ₂	0.00	0.00	0.00
TOTAL OUT	6.55	2.38	3.55

Appendix B. Sodium balance for the liquor cycle in the pulp mill of the integrated cartonboard reference mill during softwood and hardwood campaigns (kg/ADt).

	Softwood BSKP	Softwood UBSKP	Birch
Inorganics in the raw material	0.48	0.45	0.49
Make up as Na ₂ SO ₄	0.00	1.82	0.00
Sulfur-free alkali make up	4.66	4.48	0.50
Waste product from ClO ₂ -plant	4.98		4.27
External liquor supply	3.87		3.51
TOTAL IN	13.98	6.75	8.76
Wash loss	2.65	3.24	2.66
Unspecified losses black liquor	0.65	0.65	0.65
Unspecified losses white liquor and ox white liquor to effluent	0.65	0.65	0.65
Digester and evap. condensate	0.01	0.01	0.01
Dregs and grits	0.65	0.65	0.65
Sewered from CRP	0.00	1.31	1.63
Purged precipitator dust	9.12		2.27
Emission from recovery boiler, particulate	0.10	0.09	0.08
Dust from smelt dissolver	0.03	0.03	0.03
Emission from lime kiln, particulate	0.01	0.01	0.01
Dumped dust from lime kiln	0.12	0.12	0.12
TOTAL OUT	13.98	6.75	8.76

Appendix C. Specific power consumption and generation in the integrated cartonboard reference mill during softwood and hardwood campaigns, kWh/t-paper.

	Softwood campaign	Birch campaign
Power consumption		
Wood yard	24	35
Digester	29	35
Washing and O2 delignification	102	117
Bleaching	37	47
Final screening	0	0
Pulp machine	50	50
Board machine	566	566
Evaporation	34	35
White liquor production ¹	29	29
Recovery boiler ² and power boiler	112	123
Cooling towers	24	29
Raw water treatment and distribution	15	18
Effluent treatment	15	18
Chemicals preparation	21	23
Miscellaneous, losses	10	12
Sum	1 069	1 136
Sold power	421	565
Total	1 490	1 701
Power generation		
Back-pressure power	1 108	1 218
Condensing power	382	483
Bought power	0	0
Sum	1 490	1 701

¹ Includes bark dryer and gasifier

² Includes ash treatment

Appendix D. Bark balance in the in the integrated cartonboard reference mill, tDS/t-paper.

	2024	
	Softwood	Birch
Bark from woodyard	0.203	0.301
Bark to lime kiln	0.090	0.081
Bark to bark boiler	0.113	0.220

Appendix E. Specific steam consumption in the integrated reference board mill, GJ/t-paper.

	Softwood campaign	Birch campaign
Steam consumption		
Wood yard	0.00	0
Digester	1.48	1.61
O2 delignification	0.07	0.10
Bleaching	0.18	0.66
Pulp dryer	0.89	0.89
Board machine	4.36	4.36
Evaporation	2.96	3.13
White liquor production	0.00	0.00
Recovery boiler, sootblowing and blowdown	1.07	1.08
Power boiler, sootblowing and blowdown	0.02	0.05
Chemicals preparation	0.08	0.12
Miscellaneous, losses	0.40	0.44
Total	11.51	12.43

Appendix F. Energy balance for the integrated reference mill at softwood campaign.

ENERGY BALANCE**Integrated board mill, SW-campaign**

ASSUMPTIONS		Enthalpy etc kJ/kg	Temp °C	Pressure bar(g)
Make-up water before preheating		63	15	
Make-up water, preheated by sec heat		357	85	
Turbine cond., preheated by sec heat		357	85	
Feedwater to boilers		609	143	
HP-steam		3400	515	110.0
MP2-steam, desuperheated		2944	275	25.0
MP-steam, desuperheated		2814	195	9.0
LP-steam, desuperheated		2738	144	3.0
Mech./el efficiency turbine	-	0.97		
Dry solids to recovery boiler	t/d	3467		
Net useful heat from liquor	MW	409		
Bark fuel from wood yard	DS t/d	416		
from that to lime kiln	DS t/d	-185		
sold bark	DS t/d	0		
sludge etc., as wood fuel	DS t/d	0		
bark to power boiler	DS t/d	-231		
Net useful heat from fuel in bark boiler	MW	38		
	ADt/d			
Produced pulp, MCR	2000			
of which softwood	2000			
of which hardwood	0			
Market pulp	887			
Board machine	2050			

STEAM CONSUMPTION	Steam Flow t/h	Temp °C	Condensate Flow t/h	Heat Effect MW
HP-steam				
Back-pressure turbine				98.1
MP2-steam	(71.5)			
MP-steam	(238.7)			
LP-steam	(245.8)			
Condensing turbine				89.2
condensing steam	101.8	35	101.8	
Direct reduction HP-MP	(0.0)			
Direct reduction HP-LP	(0.0)			
Soot blowing recovery boiler	0.0		0.0	0.0
Blow down recovery boiler	3.0		0.0	1.1
Soot blowing bark boiler	0.0		0.0	0.0
Blow down bark boiler	0.3		0.0	0.1
Total HP-steam	105.1		101.8	188.4
MP2-steam				
Soot blowing recovery boiler	30.3		0.0	24.2
Air preheater recovery boiler	14.7	160	14.7	(9.3)
Feedwater interheater, recovery boiler	29.2	200	29.2	(17.1)
Soot blowing power boiler	0.5		0.0	0.4
Total MP2-steam	74.7		43.8	24.7
MP-steam				
Air preheater recovery boiler	18.4	170	18.4	(10.7)
Air preheater bark boiler	1.8	170	1.8	(1.1)
Feedwater preheater, recovery boiler	40.7	180	40.7	(23.3)
Digesting	45.8	170	0.0	35.0
Bleaching	0.7	180	0.0	0.5
Oxygen stage	2.1	100	0.0	1.6
Evaporation	15.5	140	14.7	9.7
Chemical preparation	0.7	100	0.0	0.5
Board machine	106.8	100	96.1	72.1
Miscellaneous, losses	7.2	100	2.2	5.3
Total MP-steam	239.8		173.9	124.8
LP-steam				
Air preheater recovery boiler	1.2	148	1.2	(0.7)
Air preheater bark boiler	2.6	148	2.6	(1.5)
Woodyard	0.0		0.0	0.0
Digesting	0.0		0.0	0.0
Bleaching	5.0		0.0	3.7
Pulp machine	32.5	100	29.2	21.2
Evaporation	100.3	140	95.2	60.6
Hot water production	0.0	130	0.0	0.0
Chemical preparation	2.1	100	1.7	1.4
Causticising	0.0	100	0.0	0.0
Board machine	48.7	105	46.3	31.3
Heating etc	0.0	100	0.0	0.0
Blow off	0.0	100	0.0	0.0
Miscellaneous, losses	5.9	100	1.8	4.2
Steam to feedwater tank	39.3		39.3	
Total LP-steam	237.5		217.2	122.5
SUMMARY STEAM CONSUMPTION	Flow t/h	Temp °C	Flow t/h	Effect MW
HP-steam	105.1		101.8	188.4
MP2-steam	74.7		43.8	24.7
MP-steam	239.8	130	173.9	124.8
LP-steam	237.5	124	217.2	122.5
Make-up water			120.2	
TOTAL STEAM CONSUMPTION	656.9		656.9	460.4

POWER CONSUMPTION	kWh/ADt	kWh/t-paper	MW
Wood yard	25	24	2.1
Digester	30	29	2.5
Washing and screening, O2 delignification	105	102	8.8
Bleaching	38	37	3.2
Pulp machine	51	50	4.3
Board machine	580	566	48.3
Evaporation	35	34	2.9
Causticising, lime kiln incl.gasifier	30	29	2.5
Boiler house	115	112	9.6
Cooling tower etc	25	24	2.1
Raw water treatment and distribution	15	15	1.3
Effluent treatment	15	15	1.3
Chem preparation	21	21	1.8
Miscellaneous, losses	10	10	0.8
Sum	1095	1 069	91.3
Sold power	432	421	36.0
Total	1527	1 490	127.2
POWER PRODUCTION			
Back-presssure power	1136	1 108	94.6
Condensing power	391	382	32.6
Bought power	0	0	0.0
Sum	1527	1 490	127.2

Appendix G. Energy balance for the integrated reference board mill at birch campaign.

ENERGY BALANCE

Integrated board mill, HW-campaign

ASSUMPTIONS		Enthalpy etc kJ/kg	Temp °C	Pressure bar(g)
Make-up water before preheating		63	15	
Make-up water, preheated by sec heat		357	85	
Turbine cond., preheated by sec heat		357	85	
Feedwater to boilers		609	143	
HP-steam		3400	515	110.0
MP2-steam, desuperheated		2944	275	25.0
MP-steam, desuperheated		2814	195	9.0
LP-steam, desuperheated		2738	144	3.0
Mech./el efficiency turbine	-	0.97		
Dry solids to recovery boiler	t/d	3522		
Net useful heat from liquor	MW	411		
Bark fuel from wood yard	DS t/d	617		
from that to lime kiln	DS t/d	-165		
sold bark	DS t/d	0		
sludge etc, as wood fuel	DS t/d	0		
bark to power boiler	DS t/d	-451		
Net useful heat from fuel in bark boiler	MW	87		
	ADt/d			
Produced pulp, MCR	2400			
of which softwood	0			
of which hardwood	2400			
Market pulp	887			
Board machine	2050			

STEAM CONSUMPTION	Steam Flow t/h	Temp °C	Condensate Flow t/h	Heat Effect MW
HP-steam				
Back-pressure turbine				107.8
MP2-steam	(75.8)			
MP-steam	(253.2)			
LP-steam	(277.5)			
Condensing turbine				112.5
condensing steam	128.2	35	128.2	
Direct reduction HP-MP	(0.0)			
Direct reduction HP-LP	(0.0)			
Soot blowing recovery boiler	0.0		0.0	0.0
Blow down recovery boiler	3.1		0.0	1.1
Soot blowing bark boiler	0.0		0.0	0.0
Blow down bark boiler	0.6		0.0	0.2
Total HP-steam	131.9		128.2	221.6
MP2-steam				
Soot blowing recovery boiler	30.7		0.0	24.6
Air preheater recovery boiler	17.6	160	17.6	(11.1)
Feedwater interheater, recovery boiler	29.6	200	29.6	(17.3)
Soot blowing power boiler	1.2		0.0	1.0
Total MP2-steam	79.1		47.2	25.5
MP-steam				
Air preheater recovery boiler	22.1	170	22.1	(12.9)
Air preheater bark boiler	4.2	170	4.2	(2.5)
Feedwater preheater, recovery boiler	41.3	180	41.3	(23.6)
Digesting	50.0	170	0.0	38.2
Bleaching	2.0	180	0.0	1.5
Oxygen stage	3.0	100	0.0	2.3
Evaporation	16.4	140	15.5	10.2
Chemical preparation	1.0	100	0.0	0.8
Board machine	106.8	100	96.1	72.1
Miscellaneous, losses	7.6	100	2.3	5.6
Total MP-steam	254.3		181.5	130.7
LP-steam				
Air preheater recovery boiler	1.4	148	1.4	(0.8)
Air preheater bark boiler	6.0	148	6.0	(3.5)
Woodyard	0.0		0.0	0.0
Digesting	0.0		0.0	0.0
Bleaching	19.0		0.0	14.1
Pulp machine	32.5	100	29.2	21.2
Evaporation	105.7	140	100.5	63.9
Hot water production	0.0	130	0.0	0.0
Chemical preparation	3.0	100	2.4	2.0
Causticising	0.0	100	0.0	0.0
Board machine	48.7	105	46.3	31.3
Heating etc	0.0	100	0.0	0.0
Blow off	0.0	100	0.0	0.0
Miscellaneous, losses	6.7	100	2.0	4.8
Steam to feedwater tank	45.0		45.0	
Total LP-steam	268.1		232.8	137.4
SUMMARY STEAM CONSUMPTION	Flow t/h	Temp °C	Flow t/h	Effect MW
HP-steam	131.9		128.2	221.6
MP2-steam	79.1		47.2	25.5
MP-steam	254.3	132	181.5	130.7
LP-steam	268.1	125	232.8	137.4
Make-up water			143.7	
TOTAL STEAM CONSUMPTION	733.4		733.4	515.3

STEAM PRODUCTION		Steam Flow t/h	Heat Effect MW
Recovery boiler	t/ADt		
HP-steam	6.14	614.4	476.2
soot blowing		0.0	0.0
blow down		3.1	0.6
feedwater preheat MP			-23.6
feedwater preheat MP2, inter eco			-17.3
air preheating, LP-steam			-0.8
air preheating, MP-steam			-12.9
air preheating, MP2-steam			-11.1
Sum		617.5	411.2
Extern överhettare			0.0
Bark boiler	t/ADt		
HP-steam	1.20	120.2	93.2
soot blowing		0.0	0.0
blow down		0.6	0.1
air preheating, LP-steam			-3.5
air preheating, MP-steam			-2.5
Sum		120.8	87.31
MP-steam from boilers (H2SO4)		0.0	0.0
desuperheating water MP2-steam		3.3	
desuperheating water MP-steam		1.1	
drainage water LP-steam		-9.4	
Secondary heat for preheating make-up water			16.8
TOTAL STEAM PRODUCTION		733.4	515.3

POWER CONSUMPTION	kWh/ADt	kWh/t-paper	MW
Wood yard	30	35	3.0
Digester	30	35	3.0
Washing and screening, O2 delignification	100	117	10.0
Bleaching	40	47	4.0
Pulp machine	43	50	4.3
Board machine	483	566	48.3
Evaporation	30	35	3.0
Causticising, lime kiln incl.gasifier	25	29	2.5
Boiler house	105	123	10.5
Cooling tower etc	25	29	2.5
Raw water treatment and distribution	15	18	1.5
Effluent treatment	15	18	1.5
Chem preparation	20	23	2.0
Miscellaneous, losses	10	12	1.0
Sum	971	1 136	97.1
Sold power	482	565	48.2
Total	1453	1 701	145.3
POWER PRODUCTION			
Back-presssure power	1040	1 218	104.0
Condensing power	412	483	41.2
Bought power	0	0	0.0
Sum	1453	1 701	145.3

REFERENCE MILL FOR INTEGRATED CARTONBOARD 2024

The purpose of this study was to update hypothetical “reference mills”, representing the state-of-the-art of pulp and paper production in the Nordic countries. These model mills have been developed in several versions going back all the way to the 1970s. The main emphasis has been on solutions which have affected energy use and electricity production. The reference mills have typically been used for benchmarking and for evaluating new process concepts in relation to the reference concept.

This report describes a mill that produces liquid packaging board from kraft pulp produced internally. The mill would be self-sufficient in both power and steam with only the recovery boiler and back pressure turbine. The mill has a power boiler to make use of surplus bark and wood waste, and for sludge recovery. There is an excess of steam from the recovery and power boilers which is utilized in a condensing turbine to produce renewable power for export.

Ett nytt steg i energiforskningen

Forskningsföretaget Energiforsk initierar, samordnar och bedriver forskning och analys inom energiområdet samt sprider kunskap för att bidra till ett robust och hållbart energisystem. Energiforsk är ett politiskt neutralt och icke vinstutdelande aktiebolag som ägs av branschorganisationerna Energiföretagen Sverige och Energigas Sverige, det statliga affärsverket Svenska kraftnät, samt gas- och energiföretaget Nordion Energi. Läs mer på energiforsk.se.

